

Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 10/29/2018 (ENSO Neutral Condition)

Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using 4 methods: Croley's method¹, the SFWMD empirical method², a sub-sampling of Neutral years³ and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with La Nina ENSO years⁴. The results for Croley's method and the SFWMD empirical method are based on the [CPC Outlook](#).

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method ^{1*}		SFWMD Empirical Method ²		Sub-sampling of ENSO Years ³		Sub-sampling of AMO Warm + ENSO Years ⁴	
	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition	Value (ft)	Condition
Current (Oct-Mar)	N/A	N/A	0.40	Dry	1.62	Wet	-0.31	Dry
Multi Seasonal (Nov-Oct)	N/A	N/A	3.11	Wet	3.90	Wet	2.15	Normal

*Croley's Method Not Produced For This Report

See [Seasonal](#) and [Multi-Seasonal](#) tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

**Sub-sampling is a weighted average of ENSO conditions based on the ENSO forecast used.

[Tributary Hydrologic Conditions Graph:](#)

-**2458 cfs** 14-day running average for Lake Okeechobee Net Inflow through 10/28/2018. According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Dry.

- **1.73** for Palmer Index on 10/27/2018.

According to the classification in [Tributary Hydrologic Conditions](#) table, this condition is Dry.

The wetter of the two conditions above is **Dry**.

[LORS2008 Classification Tables:](#)

Lake Okeechobee Stage on 10/29/2018

Lake Okeechobee Stage: **13.76 feet**

[USACE Report for Lake Okeechobee](#)

[Lake Okeechobee Stage Hydrograph](#)

Lake Okeechobee Management Zone/Band		Bottom Elevation (feet, NGVD)	Current Lake Stage
High Lake Management Band		17.19	
Operational Band	High sub-band	16.82	
	Intermediate sub-band	16.21	
	Low sub-band	14.50	
Base Flow sub-band		12.88	← 13.76
Beneficial Use sub-band		12.82	
Water Shortage Management Band			

[Part C of LORS2008: Discharge to WCA's](#)

No releases to WCA's

[Part D of LORS2008: Discharge to Tidewater](#)

Release Guidance Flow Chart Outcome: S-79 Up to 450 cfs & S-80 Up to 200 cfs.

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Homepage](#)

LORS2008 Implementation on 10/29/2018 (ENSO Neutral Condition):

Water Supply Risk Evaluation

Status for week ending 10/29/2018:

District wide, Raindar rainfall was 0.04 inches for the week. Lake stage on 10/29/2018 was 13.76 ft, down 0.27 ft from last week.


The updated Oct 2018 Mid-Month SFWMM Dynamic Position Analysis [percentile graph](#) for Lake Okeechobee show that the current lake stage is in the Base Flow Operational Sub-Band.

The LORS2008 tributary [indices](#) are classified as **Dry**. The PDSI indicates dry condition and the LONIN is dry. The classification is based on the wetter of the two.

Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Base Flow Sub Band	M
	Palmer Index for LOK Tributary Conditions	-1.73 (Dry)	M
	CPC Precipitation Outlook	1 month: Above Normal	L
		3 months: Above Normal	L
	LOK Seasonal Net Inflow Outlook	1.62 ft	L
	ENSO Years	(Normal to Extremely Wet)	
	LOK Multi-Seasonal Net Inflow Outlook	3.90 ft (Wet)	L
ENSO Conditions			
WCAs	WCA 1: Station Average (Site 1-7, Site 1-8T, Site 1-9)	Line1 – Line 2 (16.43 ft)	M
	WCA 2A: Site 2-17	Above Line 1 (12.99 ft)	L
	WCA-3A: 3 Station Average (Site 63, 64 and 65)	Above Line 1 (9.89 ft)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L

Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.


Lake Okeechobee SFWMM Oct 2018 Mid-Month Position Analysis

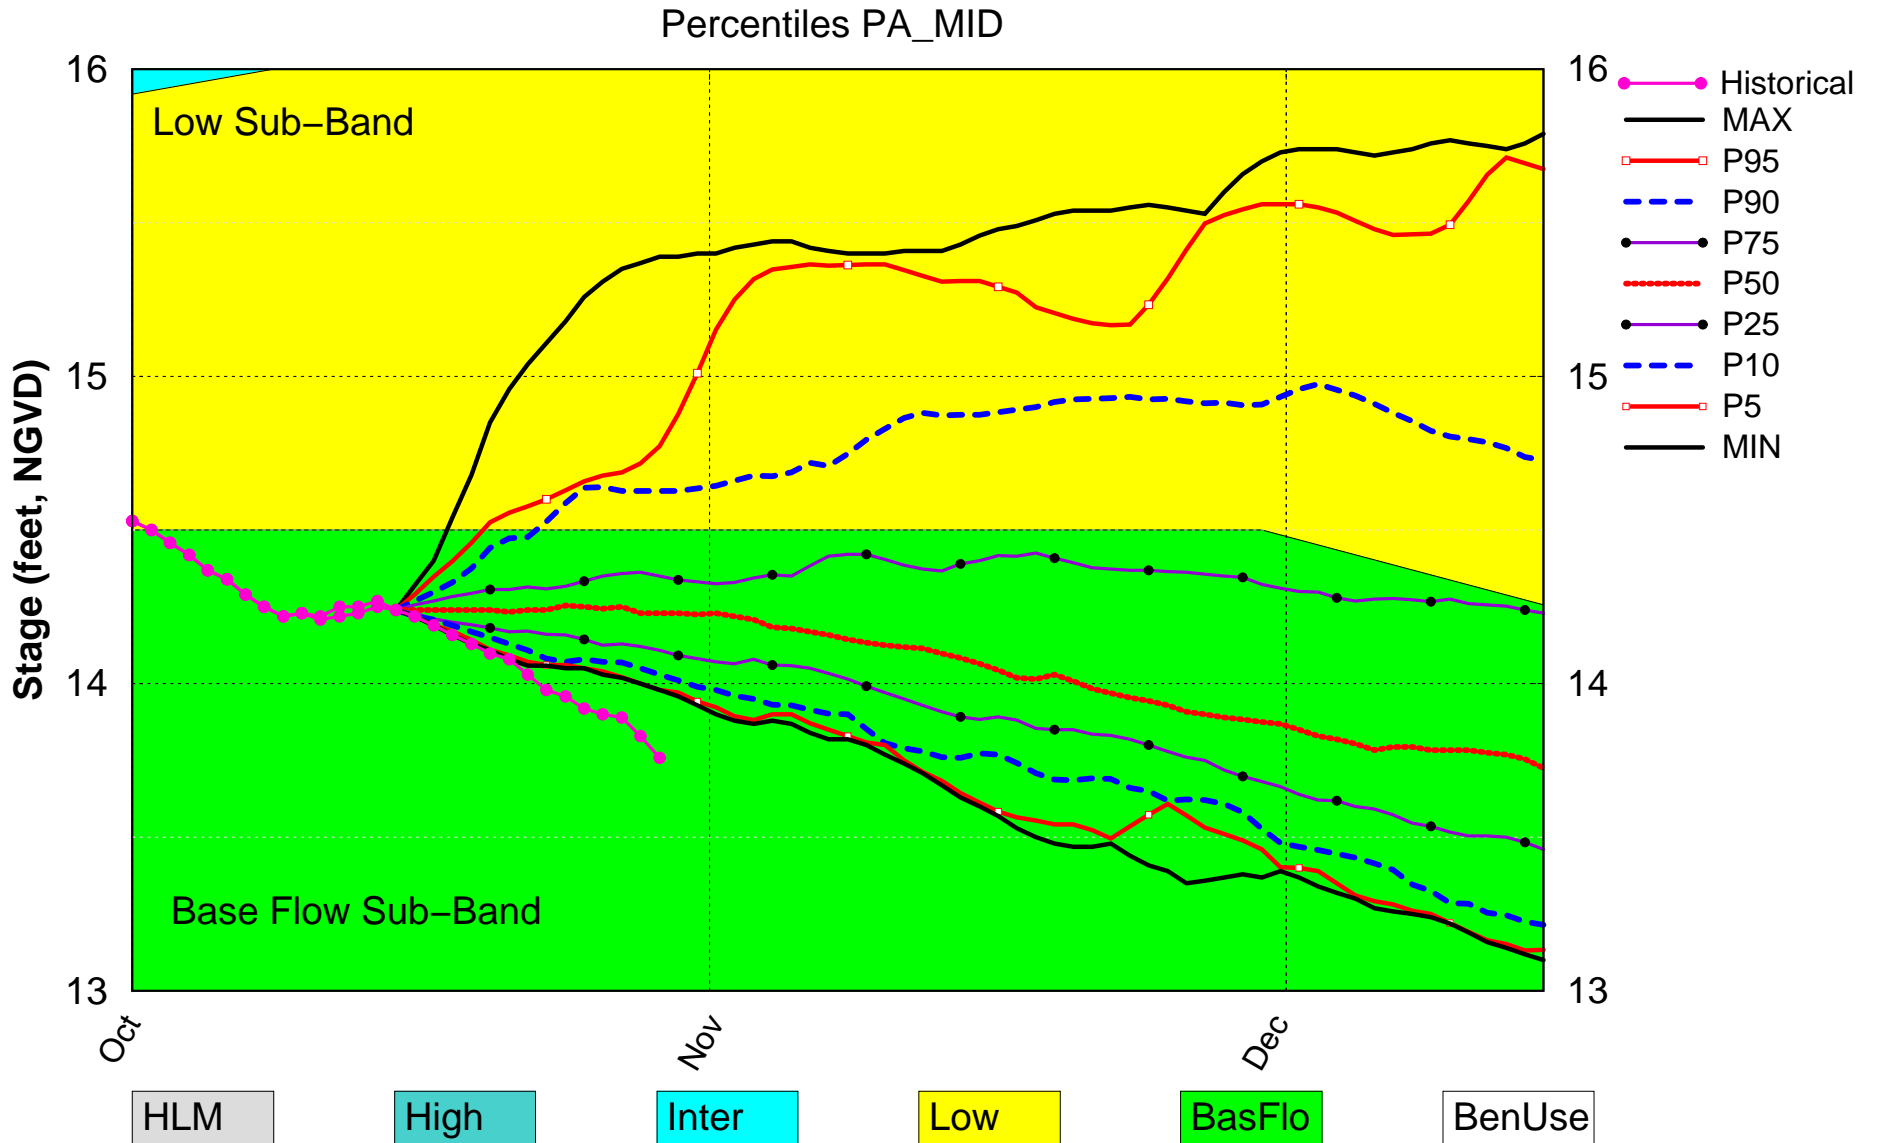


(See assumptions on the Position Analysis Results website)

Tributary Basin Condition Indicators as of October 29 2018

Palmer Index

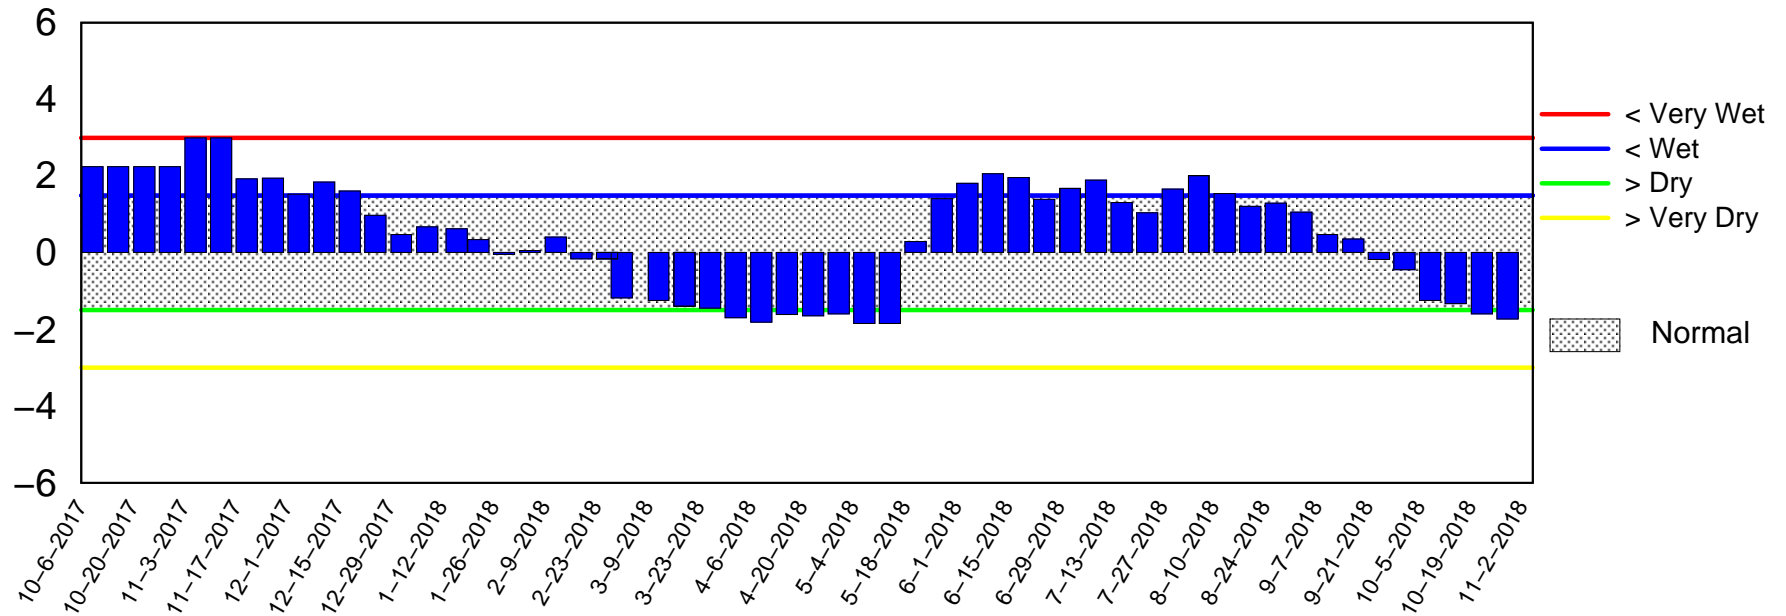

Lake Okeechobee Net Inflow (LONIN) 14-day Running Average

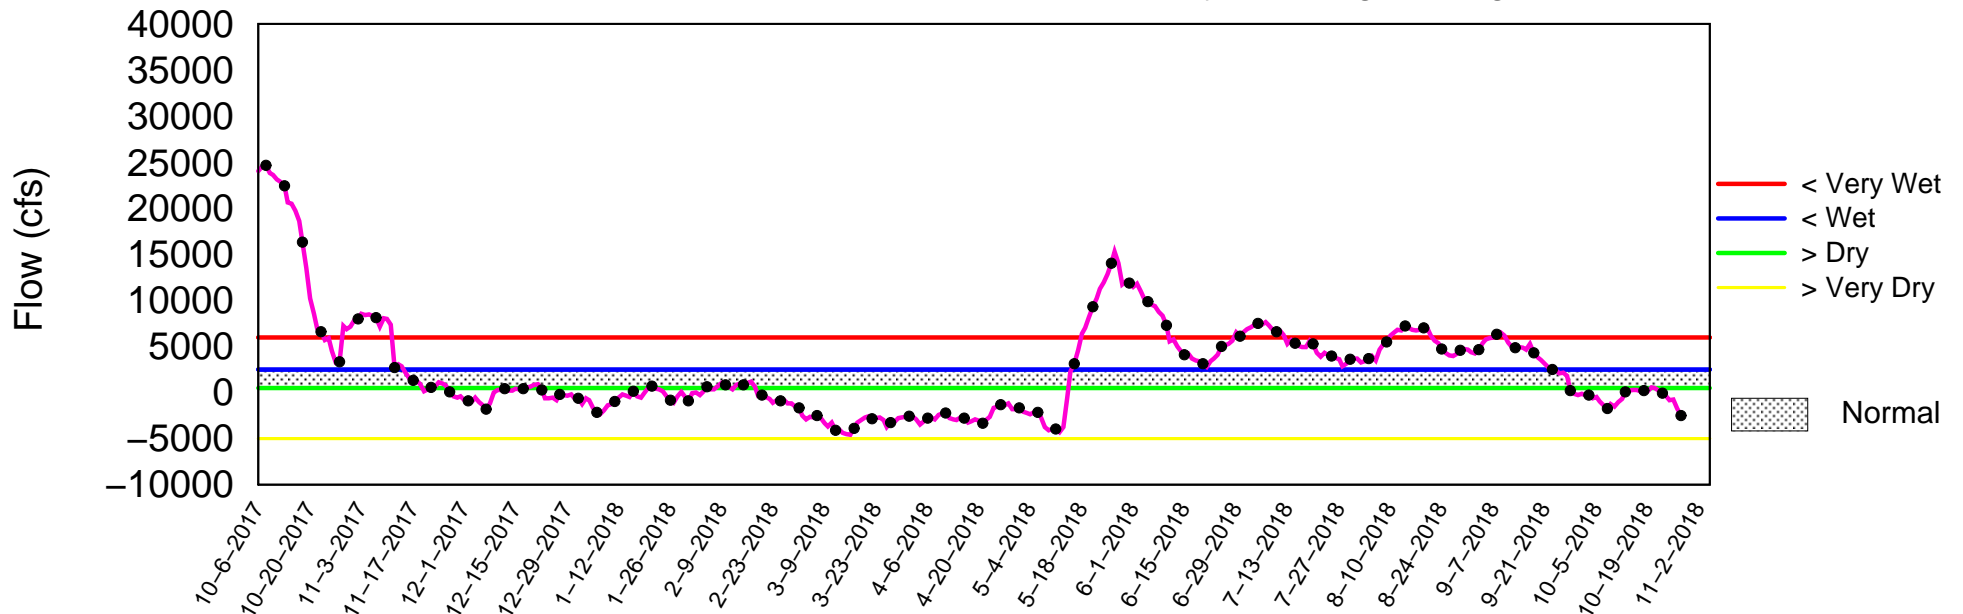

Mon Oct 29 15:22:32 EDT 2018

2008 LORS

Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

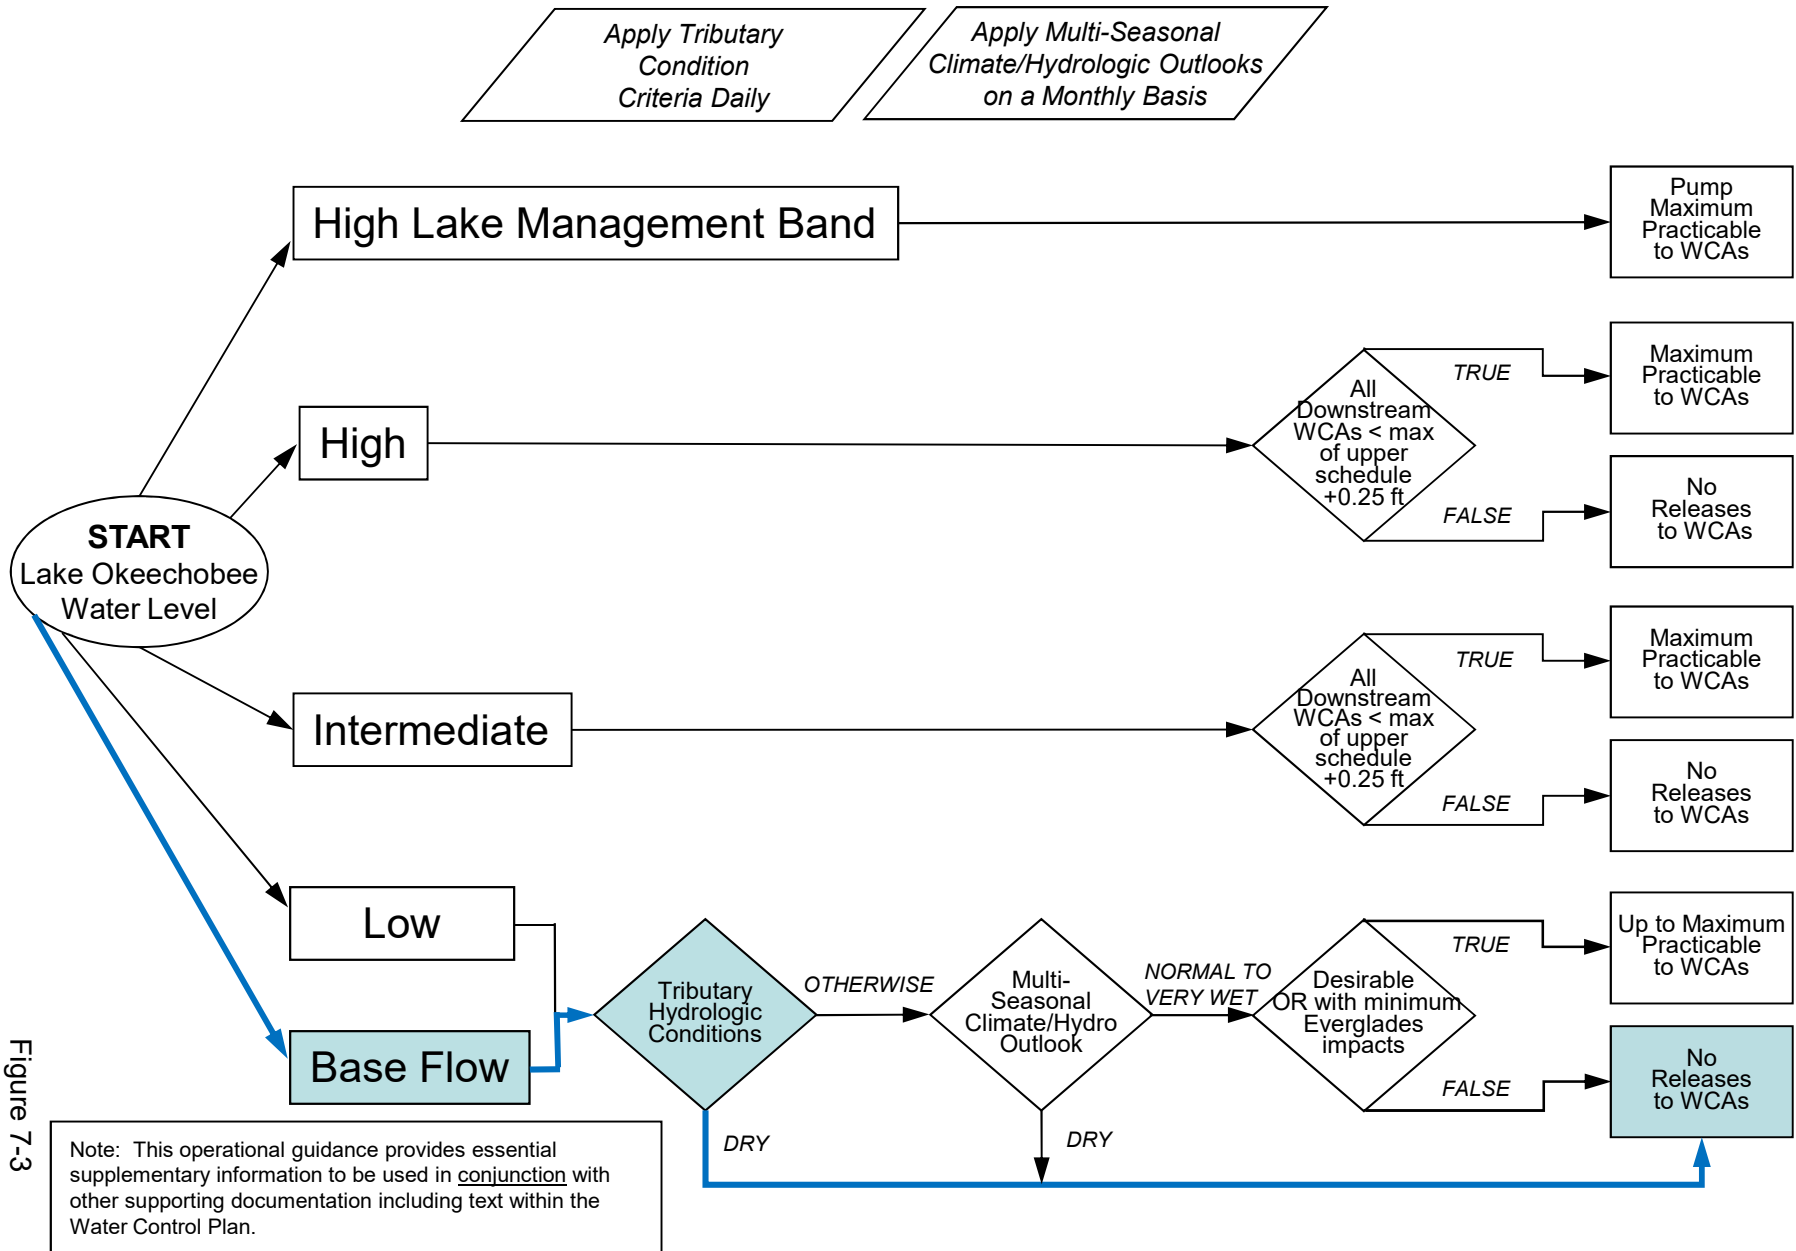


Figure 7-3

2008 LORS

Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis


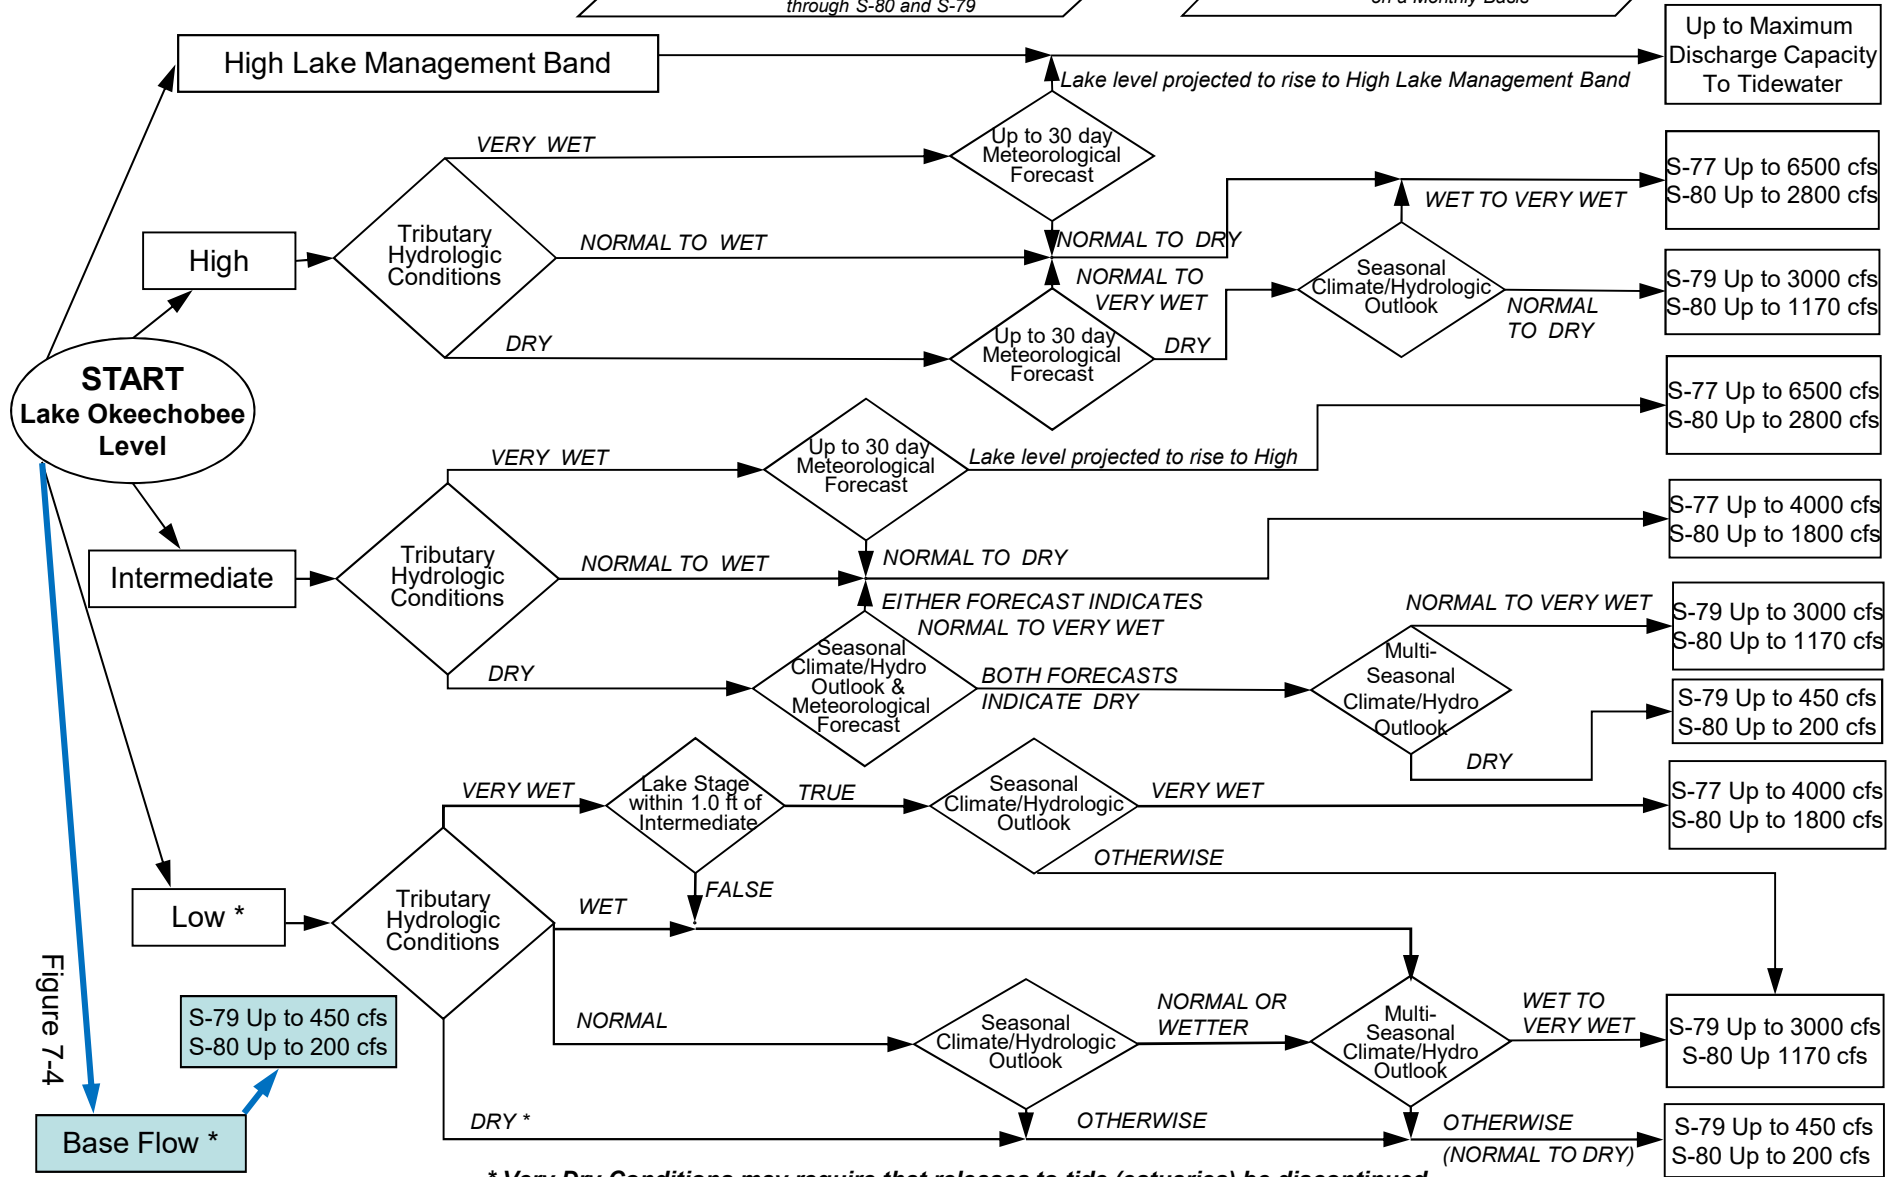


Figure 7-4

* Very Dry Conditions may require that releases to tide (estuaries) be discontinued

Flowchart to Guide Recommendations for Lake Okeechobee Releases to the Caloosahatchee Estuary for 2008 LORS Baseflow & for Environmental Water Supply (revised 9-Aug-2012)

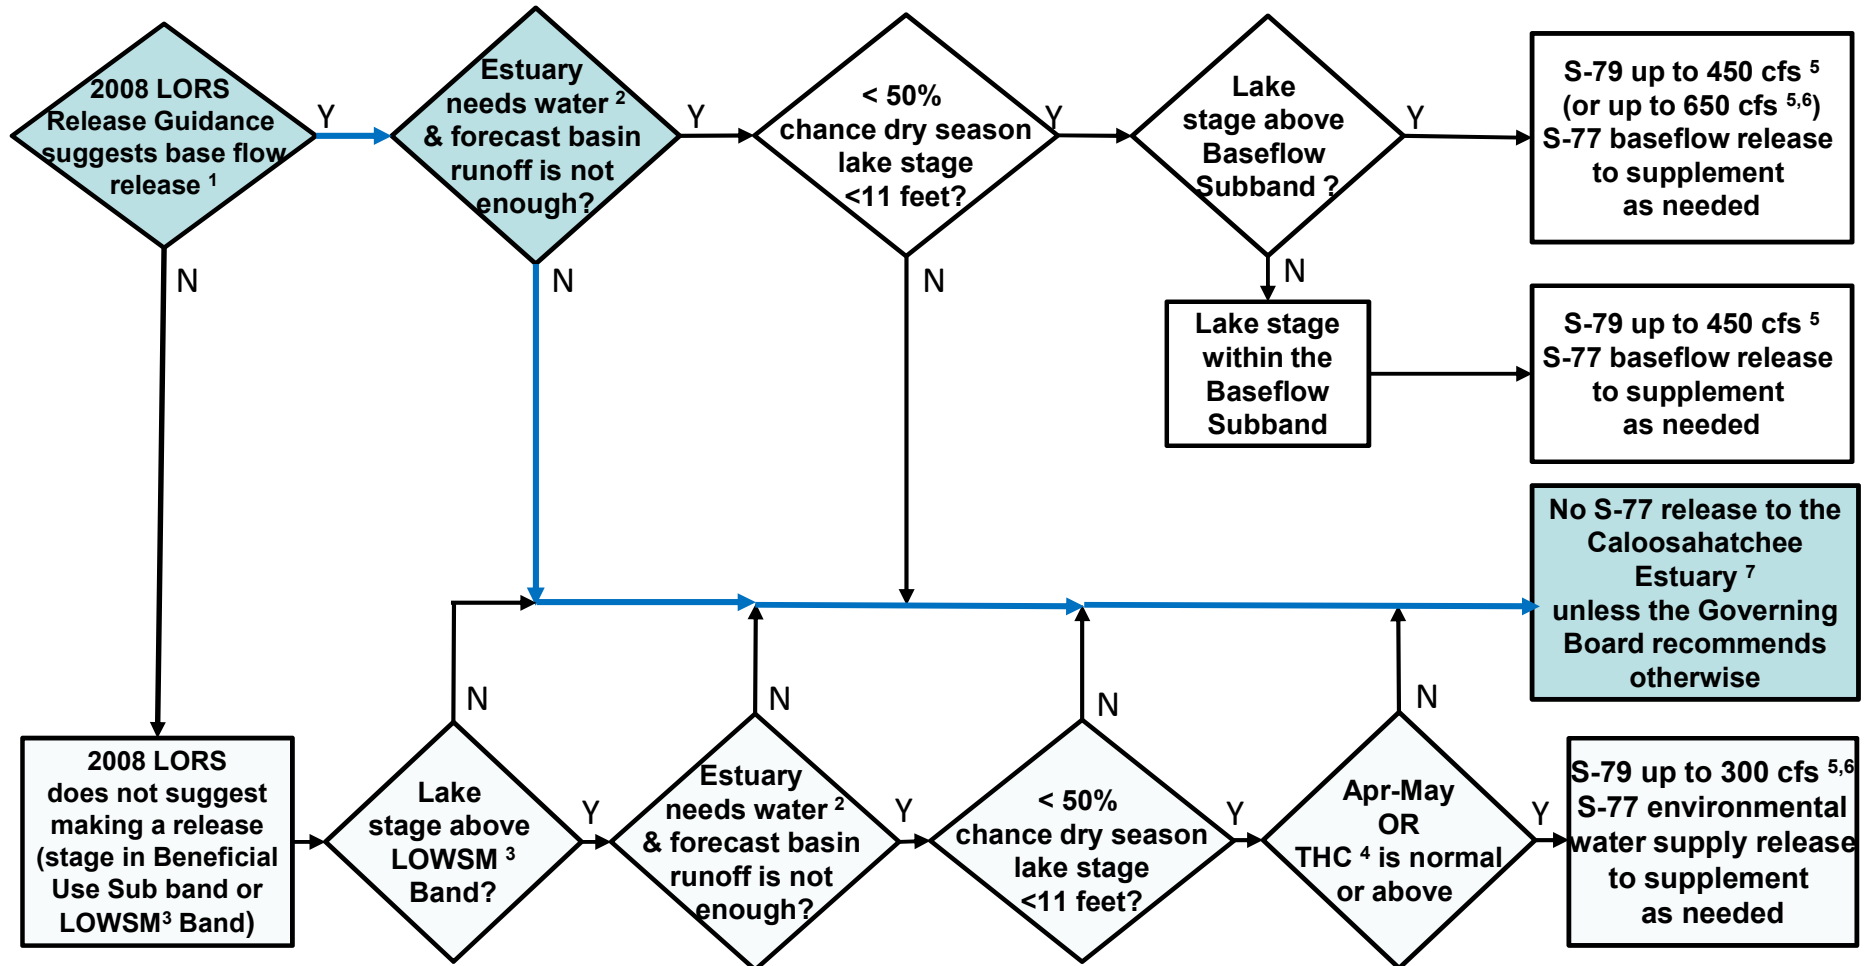

¹The 2008 LORS Release Guidance (Part D) can suggest baseflow releases in the Intermediate, Low, or Baseflow Subbands.

²Estuary “needs” water when the 30-day moving average salinity at I-75 bridge is projected to exceed 5 practical salinity units (psu) within 2 weeks.

³LOWSM = Lake Okeechobee Water Shortage Management.


⁴Tributary Hydrologic Condition (THC) is based on classification of Lake Okeechobee Net Inflow and Palmer Index.

⁵Can release less than the “up to” limit if lower release is sufficient to reach or sustain desired estuary salinity; cfs = cubic feet per second.

⁶After reviewing conditions in Water Conservation Areas (WCAs), Stormwater Treatment Areas (STAs), ENP, St. Lucie Estuary and Lake Okeechobee.

⁷Should this condition be reached, the Governing Board will be briefed at their next regularly scheduled meeting as part of the State of the Water Resources agenda item.

Lake Okeechobee Water Level History and Projected Stages

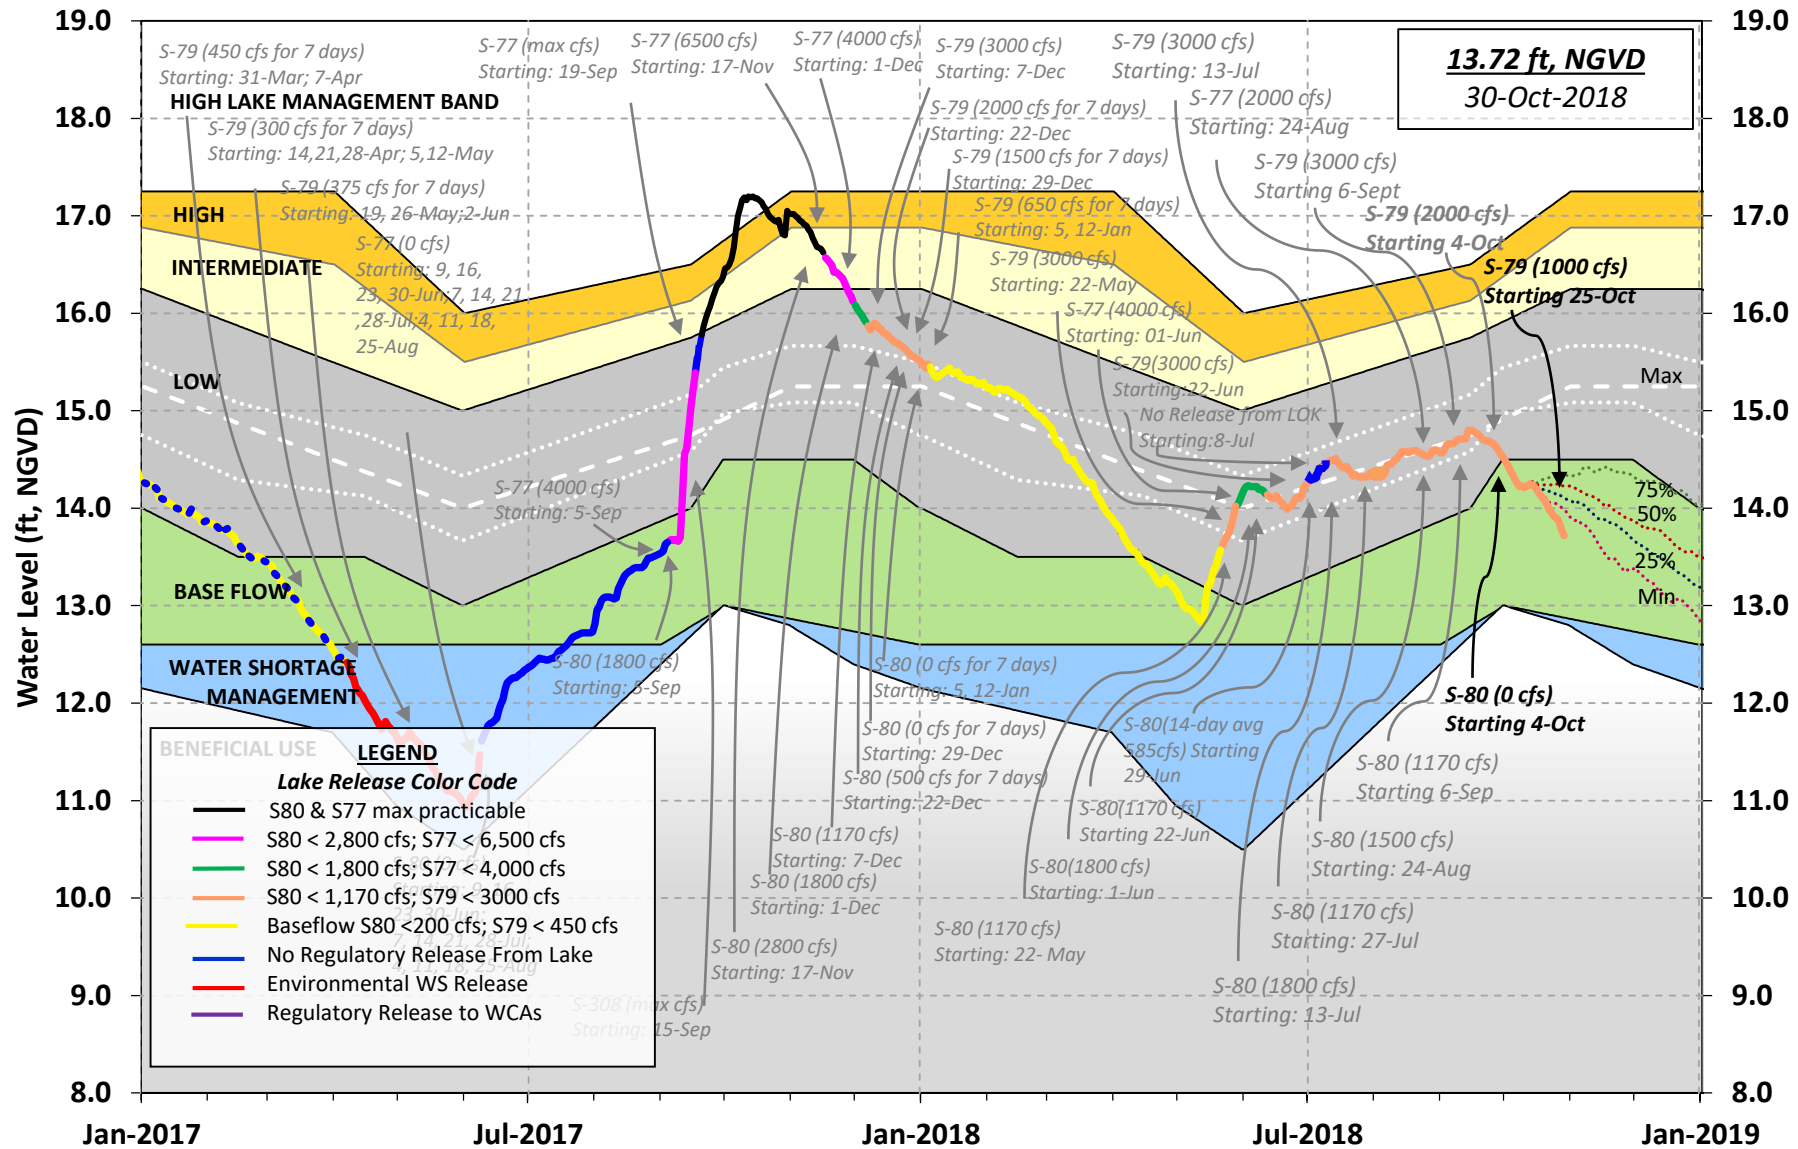

U. S. Army Corps of Engineers, Jacksonville District
 Lake Okeechobee and Vicinity Report
 ** Preliminary Data - Subject to Revision **

Data Ending 2400 hours 28 OCT 2018

Okeechobee Lake Regulation	Elevation	Last Year	2YRS Ago
	(ft-NGVD)	(ft-NGVD)	(ft-NGVD)
*Okeechobee Lake Elevation	13.76	16.80	15.53 (Official Elv)
Bottom of High Lake Mngmt=	17.19	Top of Water Short Mngmt=	12.82
Currently in Operational Management Band			

Simulated Average LORS2008 [1965-2000]	13.98
Difference from Average LORS2008	-0.22

28OCT (1965-2007) Period of Record Average	15.04
Difference from POR Average	-1.28

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1 ÷ 7.70'
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2 ÷ 5.90'
 Bridge Clearance = 49.86'

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
13.54	13.82	13.87	13.74	13.97	13.94	13.69	13.50

*Combination Okeechobee Avg-Daily Lake Average = 13.76
 (*See Note)

Okeechobee Inflows (cfs):

S65E	0	S65EX1	554	Fisheating Cr	12
S154	0	S191	0	S135 Pumps	0
S84	0	S133 Pumps	0	S2 Pumps	0
S84X	0	S127 Pumps	0	S3 Pumps	0
S71	0	S129 Pumps	0	S4 Pumps	0
S72	0	S131 Pumps	0	C5	0
Total Inflows:	566				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	1025	S77	979
S127 Culverts	-6	S351	1995	S308	-118
S129 Culverts	0	S352	886		
S131 Culverts	0	L8 Canal Pt	204		
Total Outflows:	4964				

****S77 below flow meter is being used to compute Total Outflow.

****S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77	0.13	S308	0.26
Average Pan Evap x 0.75 Pan Coefficient = 0.15" = 0.01'			

Lake Average Precipitation using NEXRAD: = 0.00" = 0.00'

Evaporation - Precipitation: = 0.15" = 0.01'
 Evaporation - Precipitation using Lake Area of 730 square miles
 is equal to 2871 cfs out of the lake.
 Lake Okeechobee (Change in Storage) Flow is -14823 cfs or -29400 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs) (I) see note at bottom	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
North East Shore											
S133 Pumps:	13.31	13.64	0	0	0	0	0	0	0		(cfs)
S193:											
S191:	17.58	13.63	0	0.0	0.0	0.0					
S135 Pumps:	13.24	13.61	0	0	0	0	0				(cfs)
S135 Culverts:			0	0.0	0.0						
North West Shore											
S65E:	20.94	13.58	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
S65EX1:	20.94	13.58	554								
S127 Pumps:	13.34	13.68	0	0	0	0	0	0	0		(cfs)
S127 Culvert:			-6	1.0							
S129 Pumps:	12.89	13.73	0	0	0	0					(cfs)
S129 Culvert:			0	0.0							
S131 Pumps:	12.92	13.72	0	0	0						(cfs)
S131 Culvert:			0								
Fisheating Creek											
nr Palmdale		28.59	12								
nr Lakeport											
C5:		-NR-	0	-NR-	-NR-	-NR-					
South Shore											
S4 Pumps:	11.14	13.81	0	0	0	0					(cfs)
S169:	13.84	11.13	10	0.0	0.0	0.0					
S310:	13.76		23								
S3 Pumps:	11.69	13.84	0	0	0	0					(cfs)
S354:	13.84	11.69	1025	1.6	1.8						
S2 Pumps:	11.76	-NR-	0	0	0	0	0				(cfs)
S351:	-NR-	11.76	1995	3.1	3.3	3.1					
S352:	13.88	11.15	886	1.5	1.7						
C10A:	-NR-	13.78		8.0	8.0	8.0	0.0	0.0			
L8 Canal PT		13.61	204								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	11.76	-NR-	1995	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-		
S352:	11.15	13.88	886	-NR-	-NR-	-NR-	-NR-				
S354:	11.69	13.84	1025	-NR-	-NR-	-NR-	-NR-				

Caloosahatchee River (S77, S78, S79)

S47B:	13.49	11.21		0.0	0.0						
S47D:	11.25	11.26	-36	6.5							

S77:

Spillway and Sector Preferred Flow:
 13.70 11.14 975 2.5 2.5 2.5 0.0
 Flow Due to Lockages+: 4

S78:

Spillway and Sector Flow:
 11.03 2.67 906 0.5 2.5 0.0 0.0
 Flow Due to Lockages+: 15

S79:

Spillway and Sector Flow:
 2.73 0.81 1696 0.0 1.0 1.0 1.0 1.0 1.0 1.0 0.0
 Flow Due to Lockages+: 14
 Percent of flow from S77 57%
 Chloride (ppm) 50

St. Lucie Canal (S308, S80)

S308:

Spillway and Sector Preferred Flow:
 13.68 13.64 -118 0.0 0.0 0.0 0.0
 Flow Due to Lockages+: 0

S153: 18.63 13.43 0 0.0 0.0

S80:

Spillway and Sector Flow:
 13.67 1.20 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0
 Flow Due to Lockages+: 18
 Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) ****
 Steele Point Bottom Salinity (mg/ml) ****

Speedy Point Top Salinity (mg/ml) ****
 Speedy Point Bottom Salinity (mg/ml) ****

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (DegØ)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	16.35	16.35	16.35	359	2
S78:	5.31	5.31	5.31	254	1
S79:	-6.03	-6.03	-6.03	270	0
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	3.98	3.98	3.98	-NR-	-NR-
S80:	0.22	0.22	0.22	17	2
Okeechobee Average	10.16	1.56	1.56		

(Sites S78, S79 and S80 not included)

Oke Nexrad Basin Avg 0.00 0.00 0.00

Okeechobee Lake Elevations	28 OCT 2018	13.76	Difference from 28OCT18
28OCT18 -1 Day =	27 OCT 2018	13.83	0.07
28OCT18 -2 Days =	26 OCT 2018	13.89	0.13
28OCT18 -3 Days =	25 OCT 2018	13.90	0.14
28OCT18 -4 Days =	24 OCT 2018	13.92	0.16
28OCT18 -5 Days =	23 OCT 2018	13.96	0.20
28OCT18 -6 Days =	22 OCT 2018	13.98	0.22
28OCT18 -7 Days =	21 OCT 2018	14.03	0.27
28OCT18 -30 Days =	28 SEP 2018	14.60	0.84
28OCT18 -1 Year =	28 OCT 2017	16.80	3.04
28OCT18 -2 Year =	28 OCT 2016	15.53	1.77

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = 3.36

Lake Okeechobee Net Inflow (LONIN)			
Average Flow over the previous 14 days			Avg-Daily Flow
28OCT18 Today =	28 OCT 2018	-2449 MON	-9738
28OCT18 -1 Day =	27 OCT 2018	-2000 SUN	-6913
28OCT18 -2 Days =	26 OCT 2018	-1011 SAT	3922
28OCT18 -3 Days =	25 OCT 2018	-1092 FRI	-197
28OCT18 -4 Days =	24 OCT 2018	-411 THU	-4042
28OCT18 -5 Days =	23 OCT 2018	-62 WED	1027
28OCT18 -6 Days =	22 OCT 2018	273 TUE	-5555
28OCT18 -7 Days =	21 OCT 2018	524 MON	-4403
28OCT18 -8 Days =	20 OCT 2018	600 SUN	1410
28OCT18 -9 Days =	19 OCT 2018	144 SAT	-2081
28OCT18 -10 Days =	18 OCT 2018	263 FRI	-2075
28OCT18 -11 Days =	17 OCT 2018	136 THU	-3026
28OCT18 -12 Days =	16 OCT 2018	248 WED	-2315
28OCT18 -13 Days =	15 OCT 2018	280 TUE	-297

S65E			
Average Flow over previous 14 days			Avg-Daily Flow
28OCT18 Today=	28 OCT 2018	134 MON	0
28OCT18 -1 Day =	27 OCT 2018	134 SUN	0
28OCT18 -2 Days =	26 OCT 2018	134 SAT	0
28OCT18 -3 Days =	25 OCT 2018	134 FRI	0
28OCT18 -4 Days =	24 OCT 2018	134 THU	0
28OCT18 -5 Days =	23 OCT 2018	134 WED	964
28OCT18 -6 Days =	22 OCT 2018	65 TUE	908
28OCT18 -7 Days =	21 OCT 2018	0 MON	0
28OCT18 -8 Days =	20 OCT 2018	0 SUN	0
28OCT18 -9 Days =	19 OCT 2018	0 SAT	0
28OCT18 -10 Days =	18 OCT 2018	0 FRI	0
28OCT18 -11 Days =	17 OCT 2018	0 THU	0
28OCT18 -12 Days =	16 OCT 2018	0 WED	0
28OCT18 -13 Days =	15 OCT 2018	0 TUE	0

S65EX1			
Average Flow over previous 14 days			Avg-Daily Flow
28OCT18 Today=	28 OCT 2018	1175 MON	554
28OCT18 -1 Day =	27 OCT 2018	1249 SUN	448
28OCT18 -2 Days =	26 OCT 2018	1337 SAT	788

28OCT18	-3 Days =	25 OCT 2018	1391	FRI		1036
28OCT18	-4 Days =	24 OCT 2018	1441	THU		1541
28OCT18	-5 Days =	23 OCT 2018	1433	WED		662
28OCT18	-6 Days =	22 OCT 2018	1498	TUE		681
28OCT18	-7 Days =	21 OCT 2018	1566	MON		1529
28OCT18	-8 Days =	20 OCT 2018	1557	SUN		1512
28OCT18	-9 Days =	19 OCT 2018	1561	SAT		1466
28OCT18	-10 Days =	18 OCT 2018	1577	FRI		1536
28OCT18	-11 Days =	17 OCT 2018	1595	THU		1553
28OCT18	-12 Days =	16 OCT 2018	1604	WED		1584
28OCT18	-13 Days =	15 OCT 2018	1621	TUE		1557

Lake Okeechobee Outlets Last 14 Days

DATE	S-77 Discharge (ALL DAY) (AC-FT)	Below S-77 Discharge (ALL-DAY) (AC-FT)	S-78 Discharge (ALL DAY) (AC-FT)	S-79 Discharge (ALL DAY) (AC-FT)
28 OCT 2018	2759	1933	1826	3386
27 OCT 2018	3281	3073	1939	3210
26 OCT 2018	2999	2557	1490	1846
25 OCT 2018	633	557	191	227
24 OCT 2018	2191	1697	795	960
23 OCT 2018	2165	1715	1301	1676
22 OCT 2018	2464	2255	1536	2482
21 OCT 2018	4549	4404	2872	3253
20 OCT 2018	4332	4117	3033	-NR-
19 OCT 2018	1912	1666	1660	-NR-
18 OCT 2018	2346	1938	1022	-NR-
17 OCT 2018	2713	1556	1713	2365
16 OCT 2018	2768	2808	1912	3267
15 OCT 2018	3257	3335	2793	3814

DATE	S-310 Discharge (ALL DAY) (AC-FT)	S-351 Discharge (ALL DAY) (AC-FT)	S-352 Discharge (ALL DAY) (AC-FT)	S-354 Discharge (ALL DAY) (AC-FT)	L8 Canal Pt Discharge (ALL DAY) (AC-FT)
28 OCT 2018	45	3956	1586	1755	404
27 OCT 2018	233	3877	1493	1515	464
26 OCT 2018	186	4009	1057	1432	532
25 OCT 2018	-NR-	3171	904	1477	532
24 OCT 2018	-NR-	2779	1001	2019	475
23 OCT 2018	-NR-	3584	1061	2546	350
22 OCT 2018	-NR-	3214	825	2421	306
21 OCT 2018	-NR-	2823	740	2175	321
20 OCT 2018	88	2758	742	2310	322
19 OCT 2018	59	2607	670	1999	309
18 OCT 2018	72	2295	615	1927	297
17 OCT 2018	24	1925	577	1951	275
16 OCT 2018	20	2128	557	2039	151
15 OCT 2018	7	2084	403	954	5

DATE	S-308 Discharge (ALL DAY) (AC-FT)	Below S-308 Discharge (ALL-DAY) (AC-FT)	S-80 Discharge (ALL-DAY) (AC-FT)
28 OCT 2018	-194	146	36
27 OCT 2018	34	10	58
26 OCT 2018	324	22	50
25 OCT 2018	191	232	35
24 OCT 2018	-67	165	32
23 OCT 2018	403	442	33

22 OCT 2018	0	118	32
21 OCT 2018	0	39	30
20 OCT 2018	0	-170	48
19 OCT 2018	478	406	46
18 OCT 2018	473	564	37
17 OCT 2018	2	198	29
16 OCT 2018	1	127	25
15 OCT 2018	2	241	18

*** NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.


(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day

* On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
 On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
 On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
 On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
 Today Lake Okechobee elevation is determined from the 4 Int & 4 Edge stations
 ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
 \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to www.sfwmd.gov

Report Generated 29OCT2018 @ 23:38 ** Preliminary Data - Subject to Revision **

Lake Okeechobee

29OCT18 14:45:23

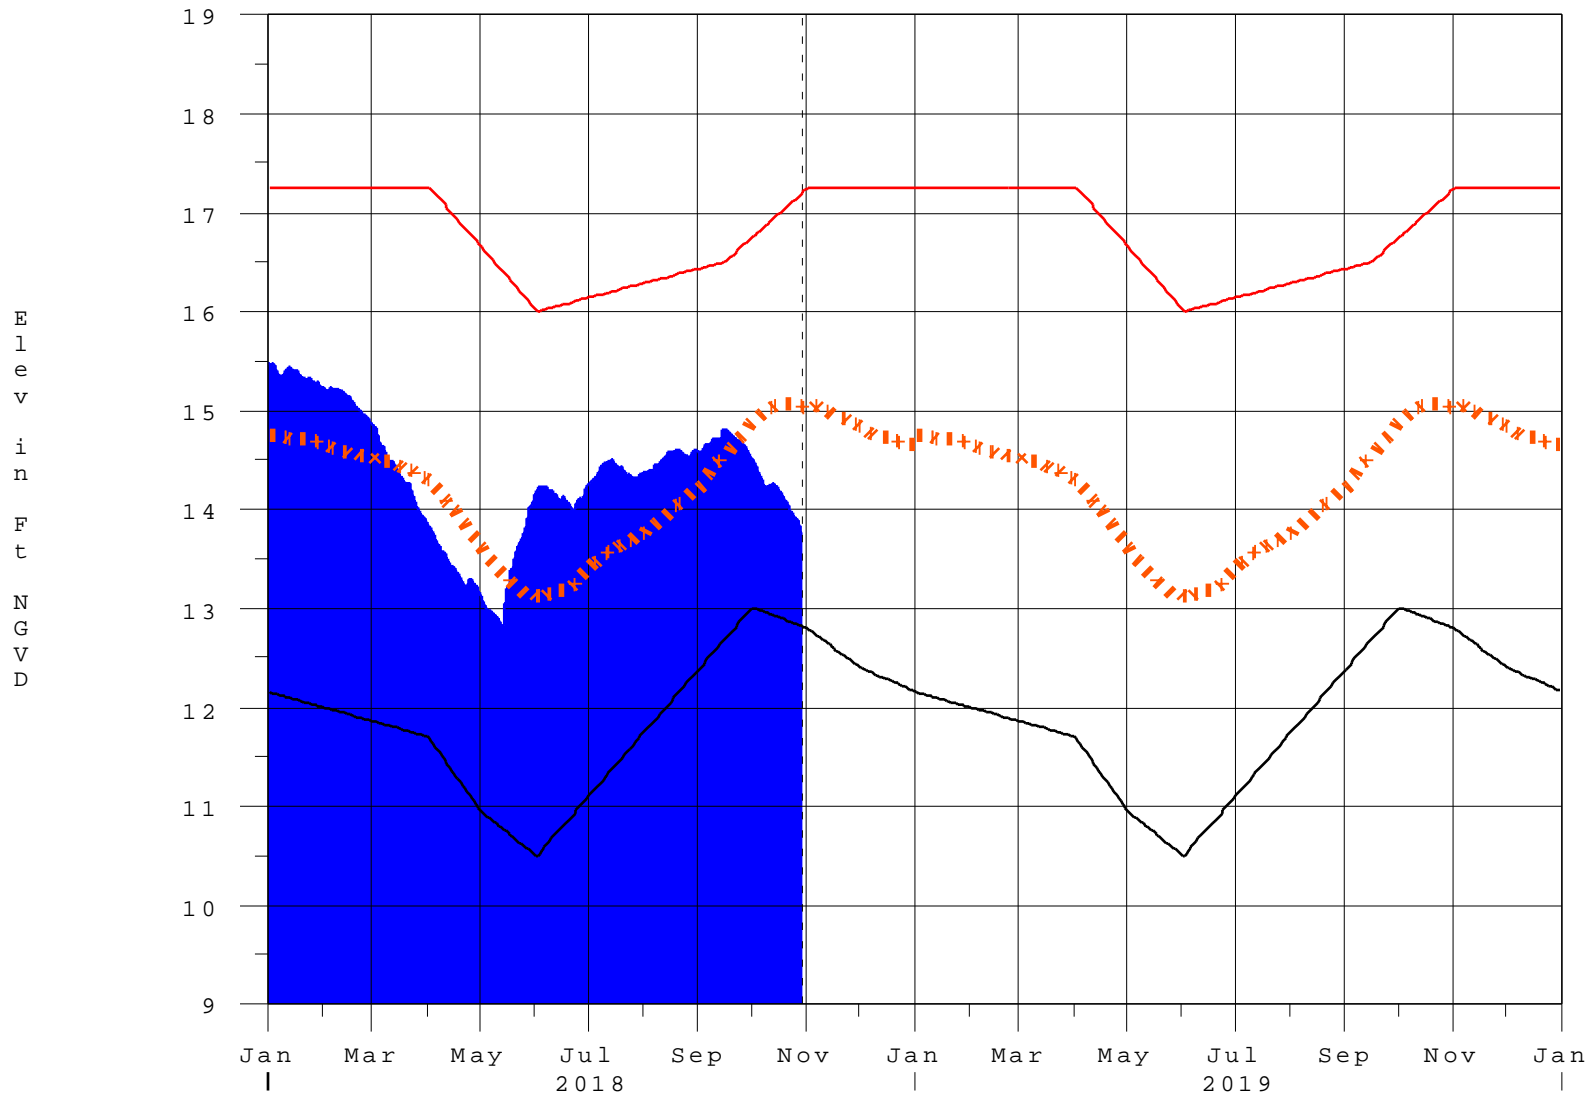

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management

Classification Tables

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater \geq 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

* use the wettest of the two indicators

Classification of Lake Okeechobee Net Inflow Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Seasonal Outlook
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook*

Lake Net Inflow Prediction [million acre-feet]	Equivalent Depth** [feet]	Lake Okeechobee Net Inflow Multi-Seasonal Outlook
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

****Volume-depth conversion based on average lake surface area of 467,000 acres**

6-15 Day Precipitation Outlook Categories*

6-15 Day Precipitation Outlook Categories	WSE Decision Tree Categories
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan

Under Construction