

# Application of the Lake Okeechobee Regulation Schedule (LORS2008) on 7/29/2024 (ENSO Condition: Neutral)

## Lake Okeechobee Net Inflow Outlook:

The Lake Okeechobee Net Inflow Outlook has been computed using methods described in the LORS2008 Water Control Plan: Croley's method, the SFWMD empirical method, a sub-sampling of Neutral years and a sub-sampling of warm years of the Atlantic Multi-decadal Oscillation (AMO) in combination with Neutral ENSO years. The results for Croley's method and the SFWMD empirical method are based on the CPC Outlook.

Table of the Lake Okeechobee Net Inflow Outlooks in feet of equivalent depth. All methods are updated on a weekly basis with observed net inflow for the current month.

Season	Croley's Method*		SFWMD Empirical Method		Sub-sampling of El Niño ENSO Years**		Sub-sampling of AMO Warm + El Niño ENSO Years***	
	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>	Value (ft)	<u>Condition</u>
Current (Jul-Dec)	N/A	N/A	1.76	Wet	1.89	Wet	3.34	Very Wet
Multi Seasonal (Jul-Apr)	N/A	N/A	1.99	Normal	1.79	Normal	3.52	Wet

\*Croley's Method Not Produced for This Report

See Seasonal and Multi-Seasonal tables for the classification of Lake Okeechobee Outlooks.

The recommended methods and values for estimating the Lake Okeechobee Net Inflow Outlook are shaded and should be used in the LORS2008 Release Guidance Flow Charts.

\*\*Sub-sampling is a weighted average of ENSO conditions based on the IRI ENSO forecast published.

\*\*\*Sub-sampling based on combination of ENSO and AMO conditions. For this predominant ENSO categorization is used instead of weights.

## **Tributary Hydrologic Conditions:**

**385 cfs** 14-day running average for Lake Okeechobee Net Inflow through 7/29/2024. According to the classification in Tributary Hydrologic Conditions table, this condition is Dry.

**-3.01** for Palmer Drought Index on 7/27/2024. According to the classification in Tributary Hydrologic Conditions table, this condition is Very Dry.

The wetter of the two conditions above is **Dry**.

## **LORS2008 Classification Tables:**

### **Lake Okeechobee Stage on 7/29/2024:**

Lake Okeechobee Stage: **13.52 feet (NGVD29), 12.27 (NAVD88) \***

Lake Okeechobee Management Zone/Band		Bottom Elevation feet, NGVD (feet NAVD)	Current Lake Stage
High Lake Management Band		16.27 (15.02)	
Operational Band	High sub-band	15.84 (14.59)	
	Intermediate sub-band	15.41 (14.16)	
	Low sub-band	13.54 (12.29)	
Base Flow sub-band		12.60 (11.35)	← 13.52 ft (12.27)
Beneficial Use sub-band		11.68 (10.43)	
Water Shortage Management Band			

\*Lake Okeechobee Stage NAVD88 offset of -1.25 is based on Final Regulation Schedule Conversion (5/19/2020).

**Part C of LORS2008: Discharge to WCAs**

No Releases to WCAs.

**Part D of LORS2008: Discharge to Tide**

Up to 450 cfs at S-79 and up to 200 cfs at S-80.

**LORS2008 Implementation on 7/29/2024 (ENSO Condition- Neutral):**

**Status for week ending 7/29/2024\*:**

**Water Supply Risk Evaluation**

Area	Indicator	Value	Color Coded Scoring Scheme
LOK	Projected LOK Stage for the next two months	Base Flow Sub-band	M
	Palmer Drought Index for LOK Tributary Conditions	-3.01 (Extremely Dry)	H
	CPC Precipitation Outlook	1 month: Above Normal	L
		3 months: Above Normal	L
	LOK Seasonal Net Inflow Outlook	1.89 ft	L
	ENSO Forecast	Normal to Extremely Wet	
	LOK Multi-Seasonal Net Inflow Outlook	1.79 ft	M
ENSO Forecast	Normal		
WCAs	WCA 1: 3 Station Average (Sites 1-7, 1-9, and 1-8T)	Above Line 1 (16.42 ft) (14.92 ft NAVD88)	L
	WCA 2A: Site 2-17	Above Line 1 (12.34 ft) (10.84 ft NAVD88)	L
	WCA-3A: 3 Station Average (Sites 63, 64, and 65)	Above Line 1 (10.67 ft) (9.17 ft NAVD88)	L
LEC	Service Area 1	Year-Round Irrigation Rule in effect	L
	Service Area 2	Year-Round Irrigation Rule in effect	L
	Service Area 3	Year-Round Irrigation Rule in effect	L


Note: The water supply risk classification based on the Palmer index, as well as the LOK seasonal and multi-seasonal net inflow outlooks use slightly different classification intervals than those used by the 2008-LORS.

---

\* S-80 flow data for 7/16-7/17, 7/19-7/20 is not available from USACE Daily Reports and was assumed to be 0. S-308 flow data for 7/18-7/21 is not available from USACE Daily Reports and was assumed to be 0. WCA1, WCA2A, and WCA3A NAVD88 offset of -1.5 is based on Final Regulation Schedule Conversion (5/19/2020).

# Lake Okeechobee SFWMM July 2024 Position Analysis

Percentiles PA


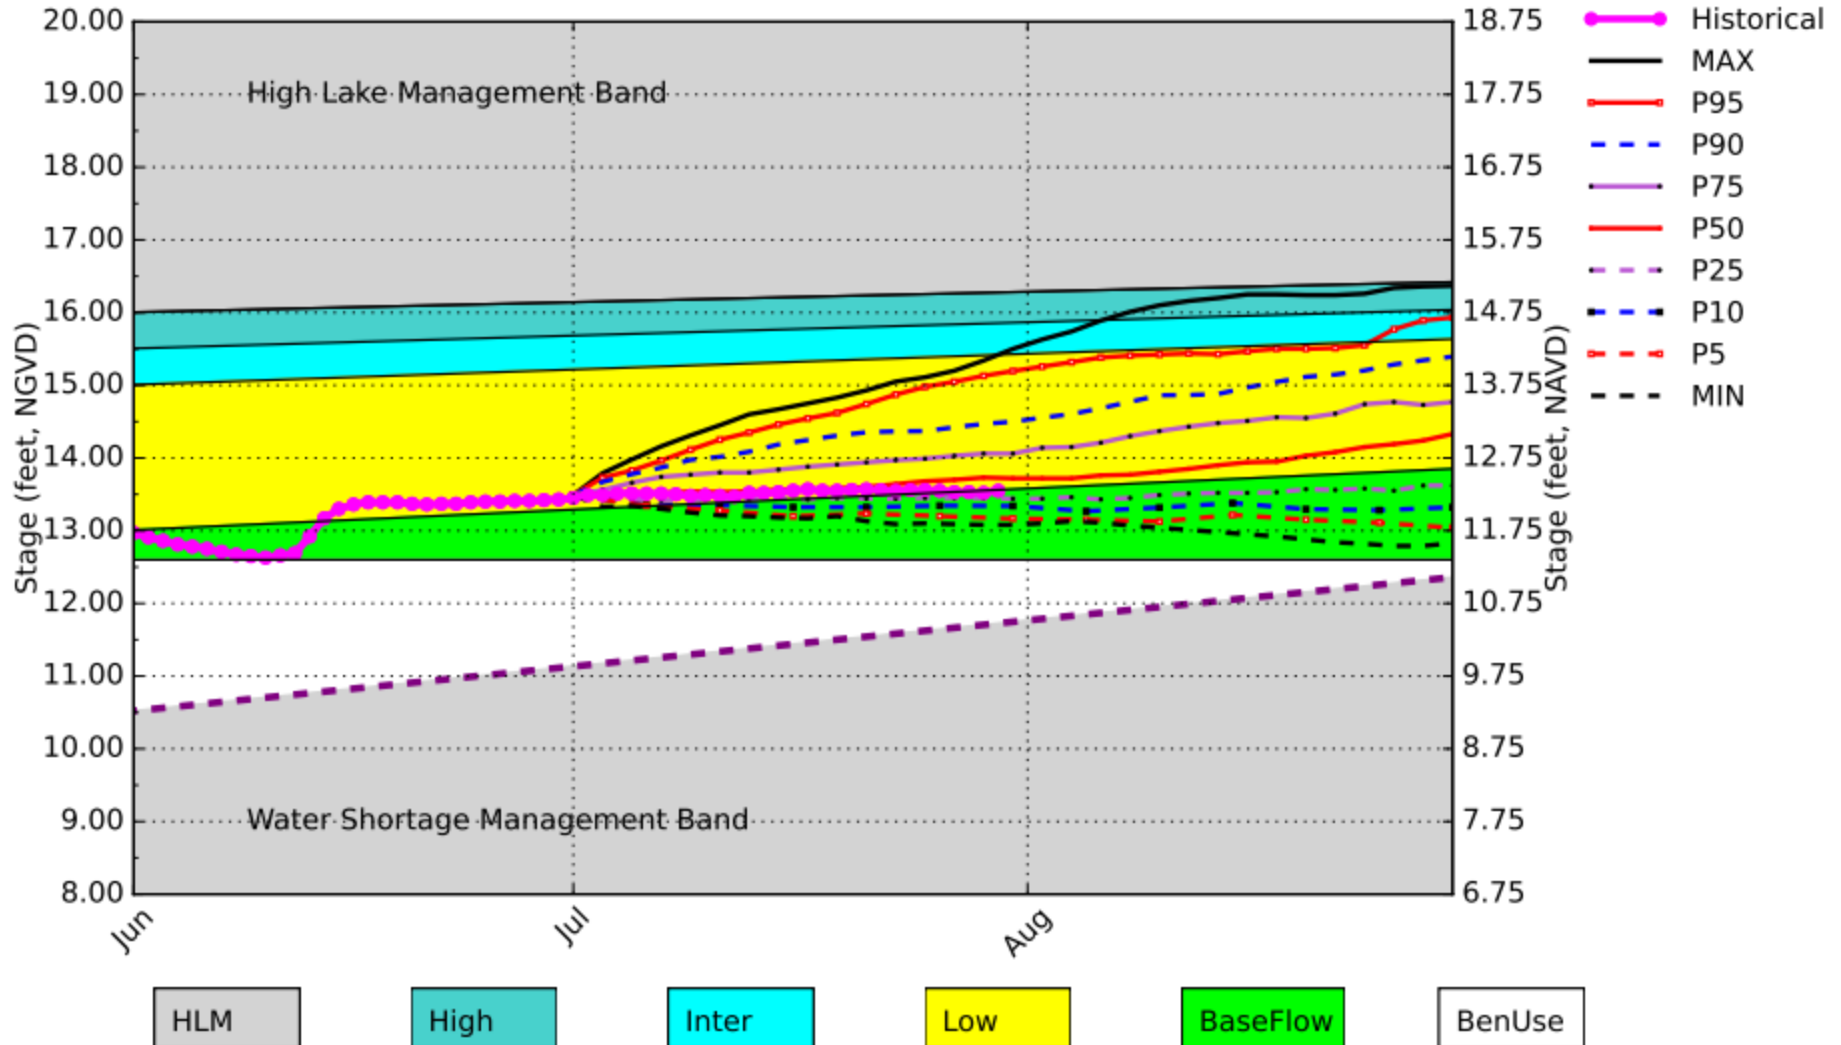


07/30/24 08:16:14

(See assumptions on the Position Analysis Results website)

\* Lake Okeechobee stage NAVD88 offset of -1.25 is based on Final Regulation Schedule Conversion (5/19/2020).

Tributary Basin Condition Indicators as of July 28 2024

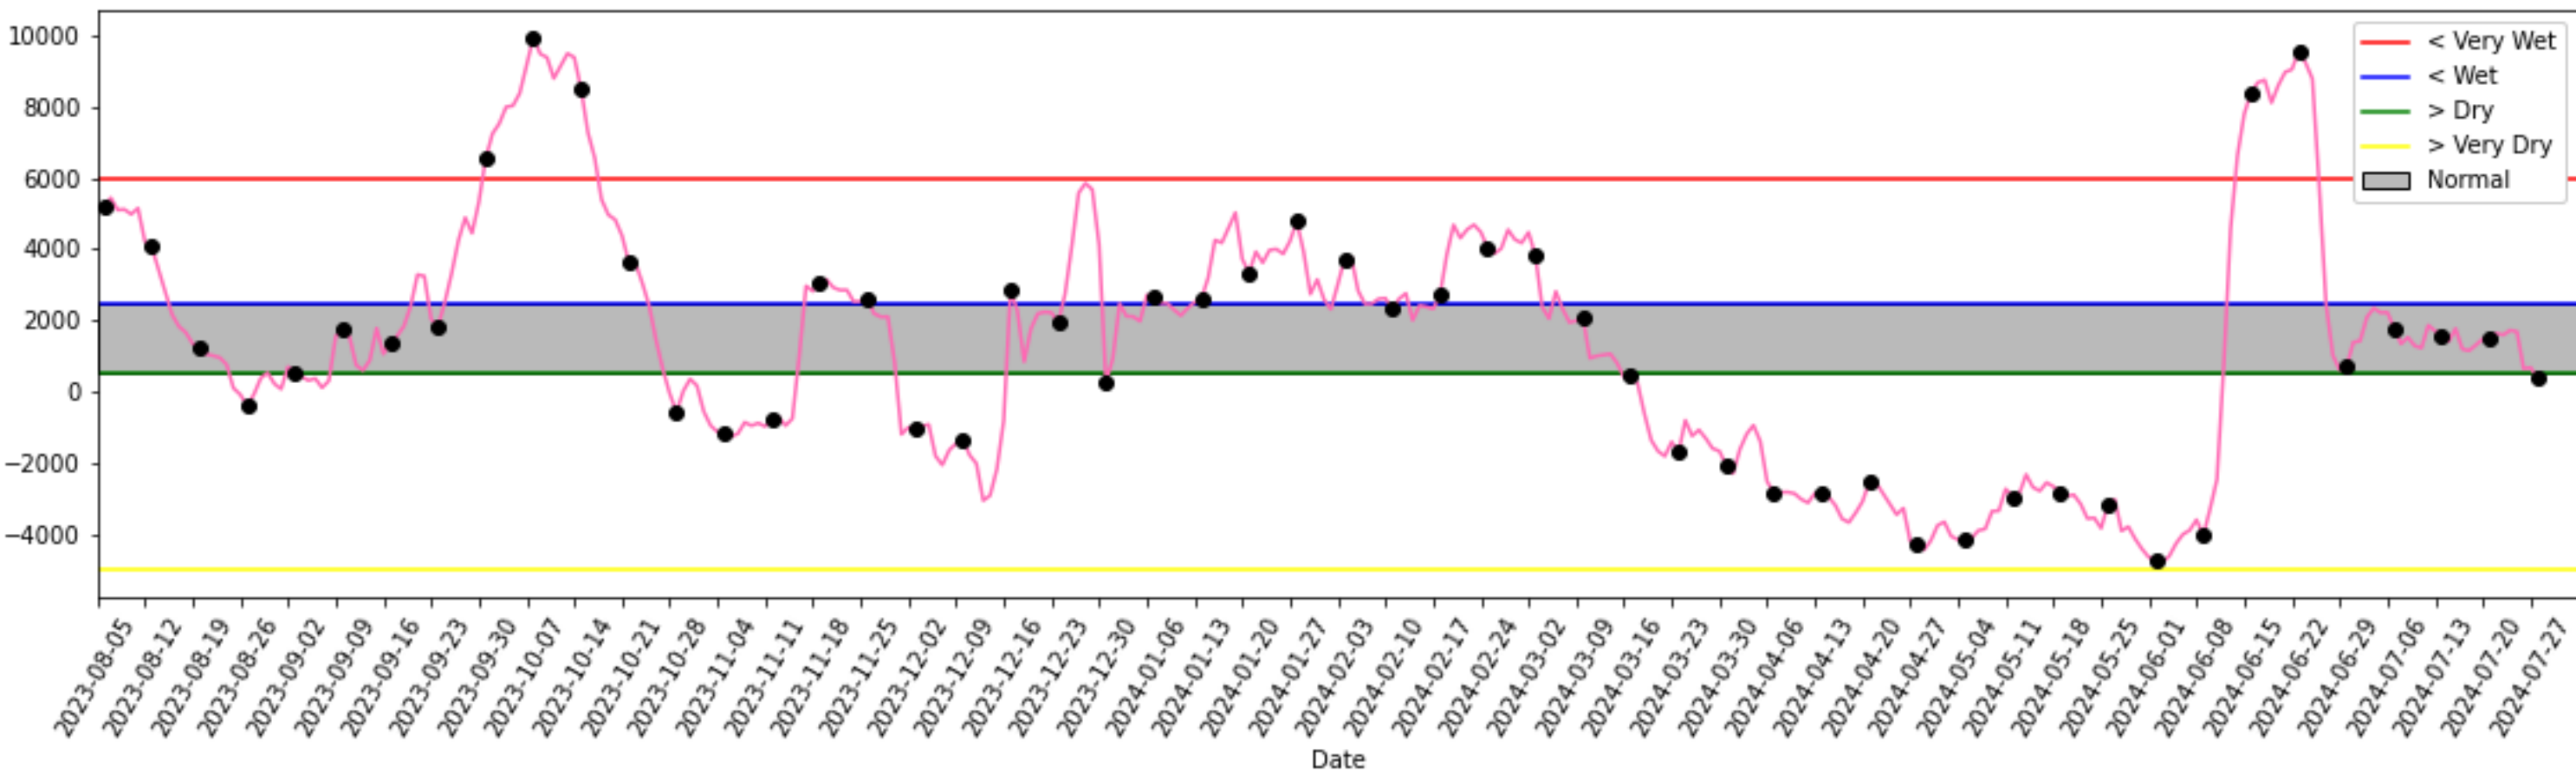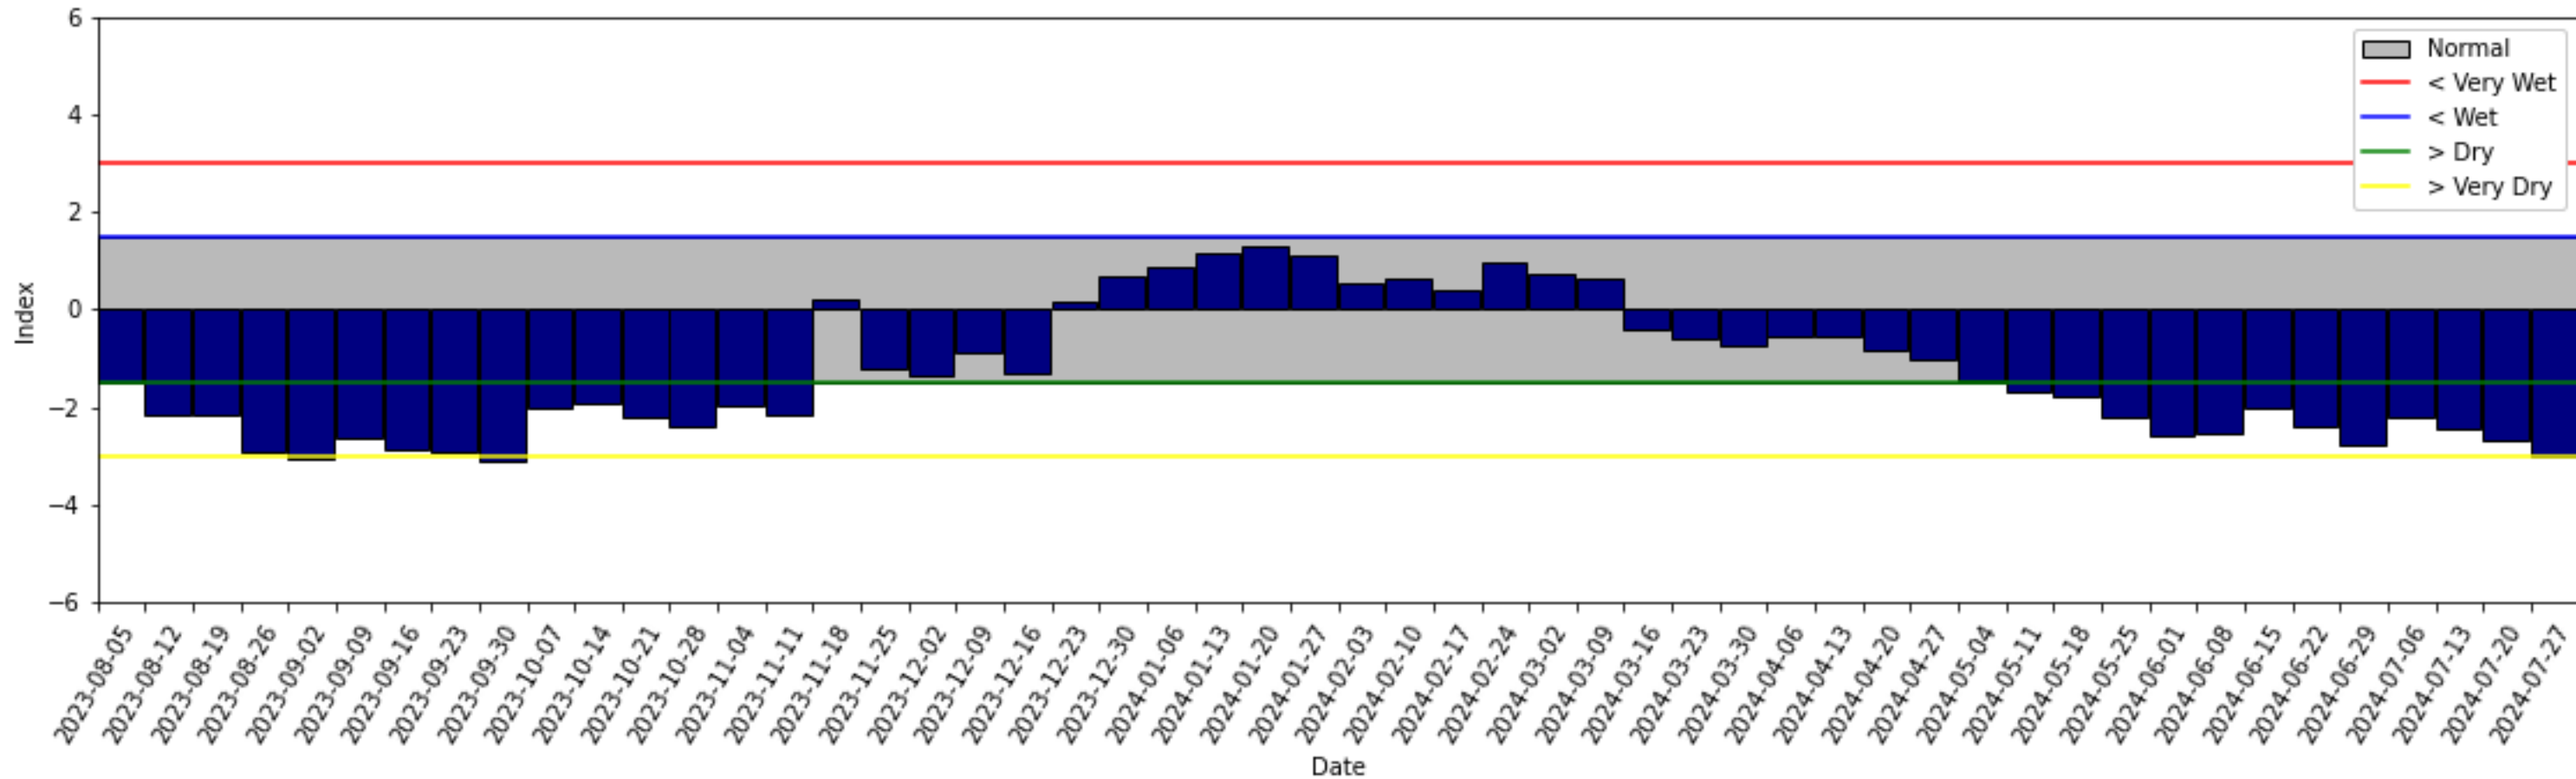

# 2008 LORS

## Part C: Establish Allowable Lake Okeechobee Releases to the Water Conservation Areas

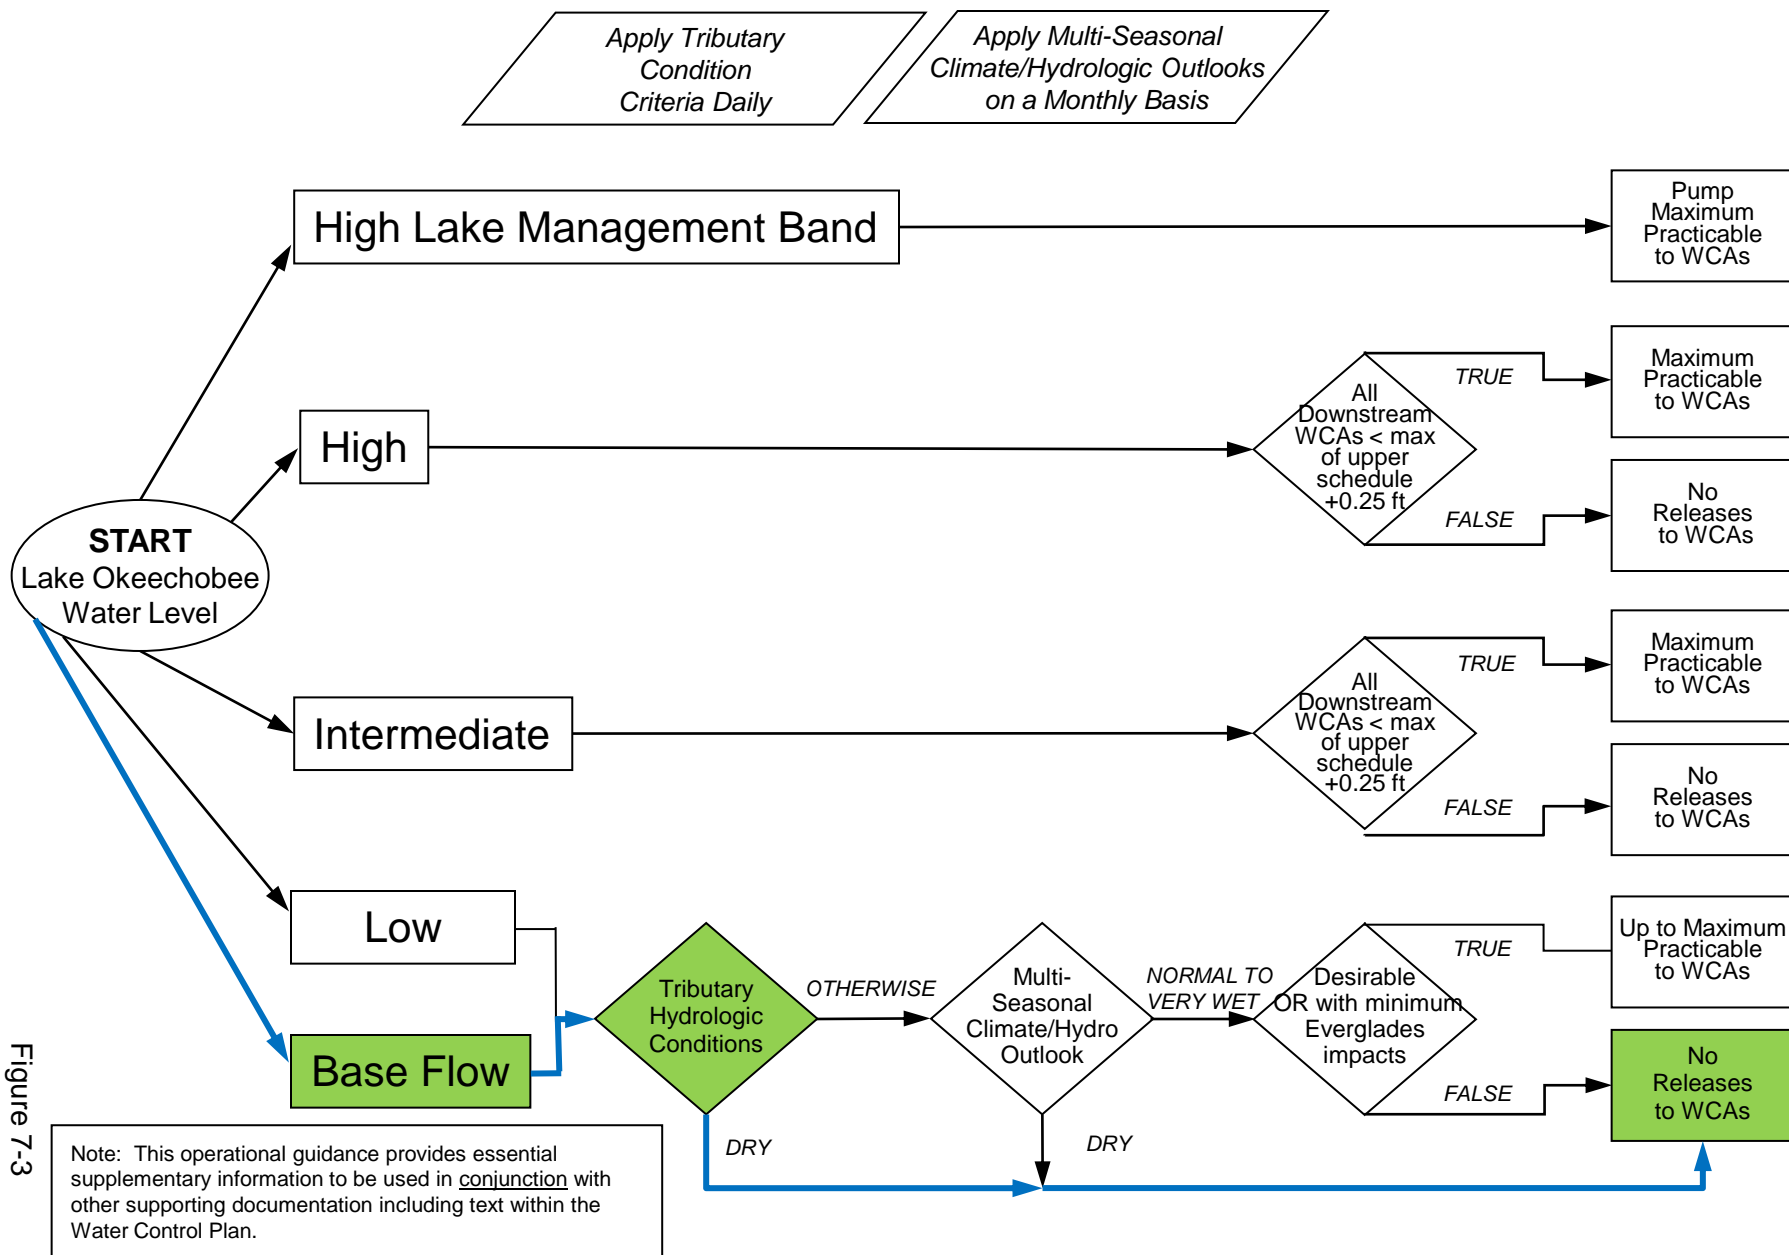


Figure 7-3

# 2008 LORS

## Part D: Establish Allowable Lake Okeechobee Releases to Tide (Estuaries)

Note: This operational guidance provides essential supplementary information to be used in conjunction with other supporting documentation including text within the Water Control Plan.

When conducting Base Flow releases, flows can be distributed East and West up to 650 cfs as needed to minimize impacts or provide benefits through S-80 and S-79

Apply Meteorological Forecasts on a Weekly Basis; apply Seasonal and Multi-Seasonal Climate/Hydrologic Outlooks on a Monthly Basis


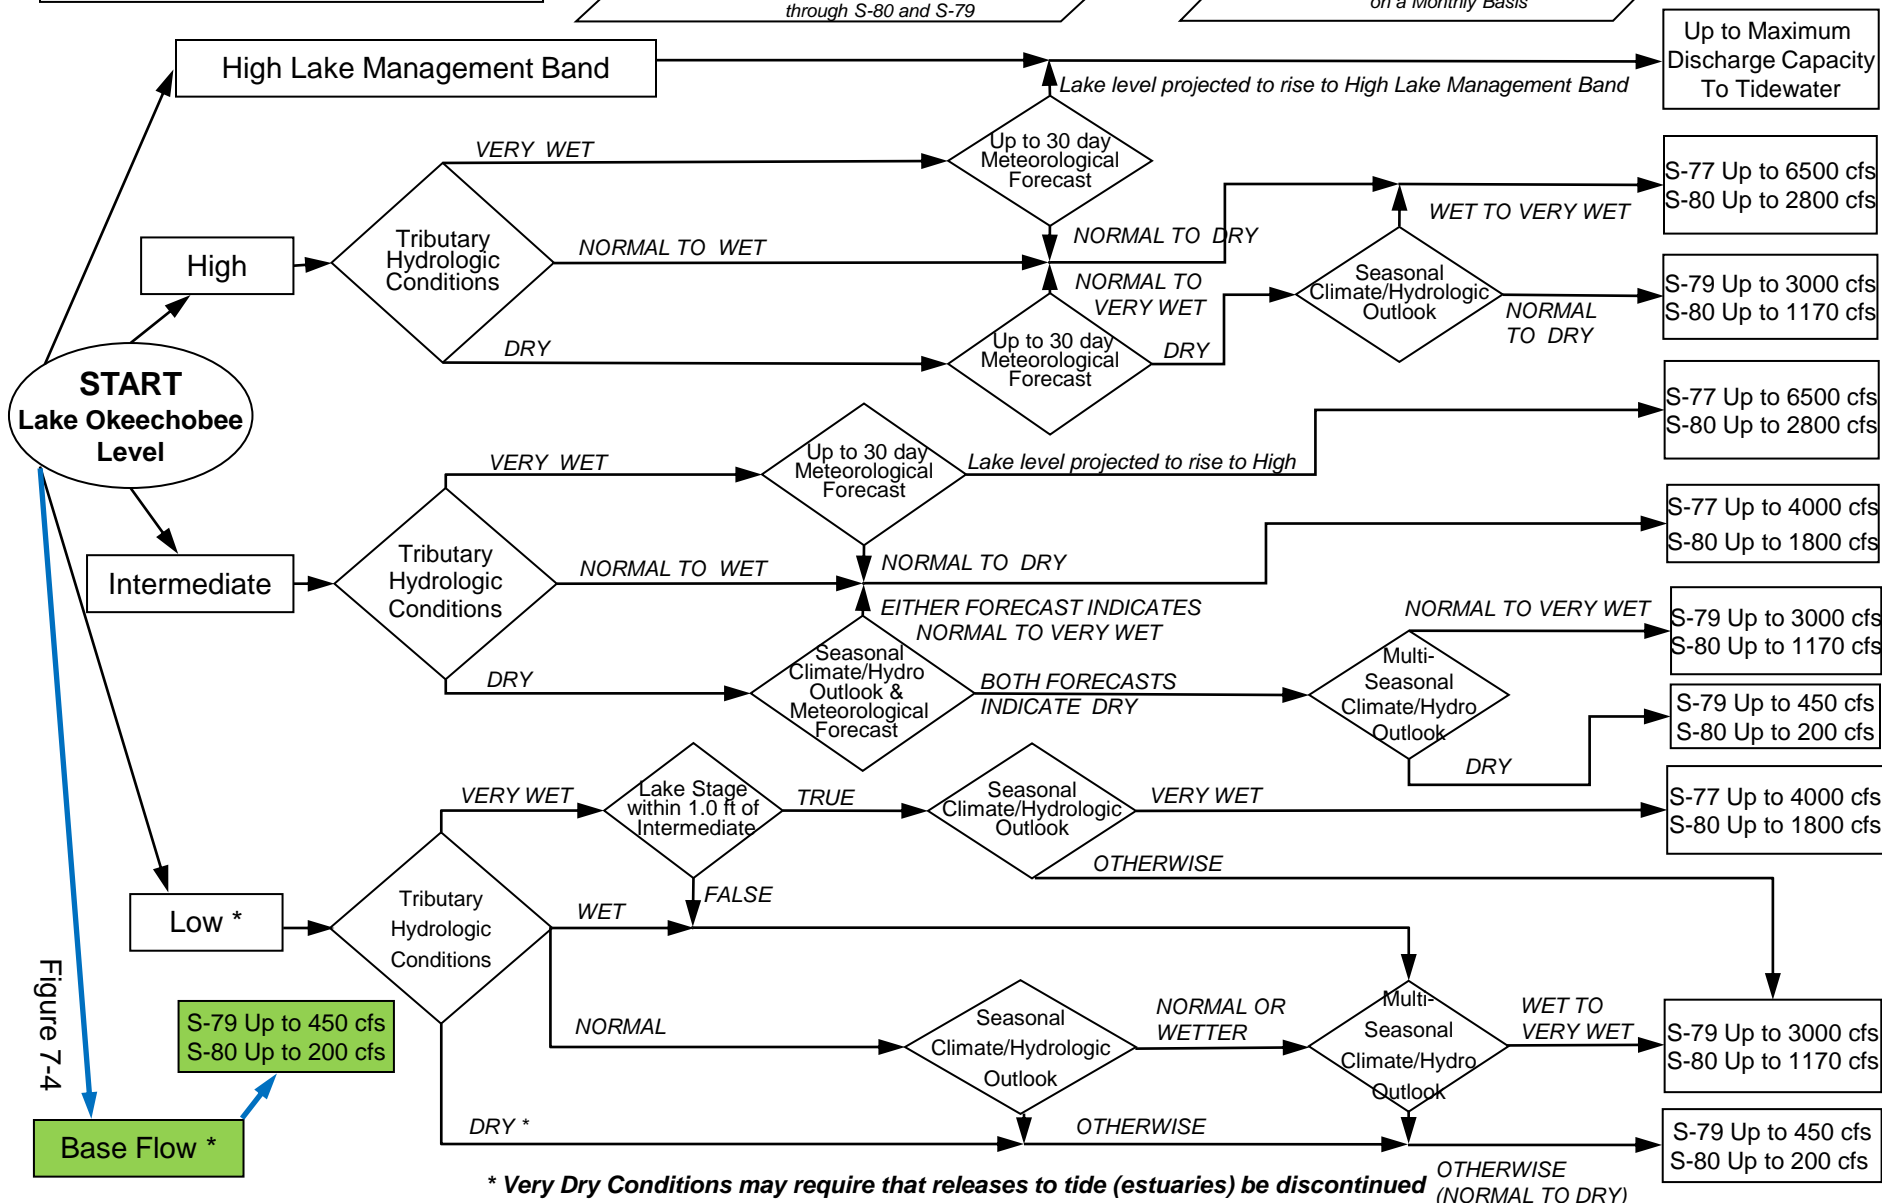


Figure 7-4



# Lake Okeechobee Water Level History and Projected Stages

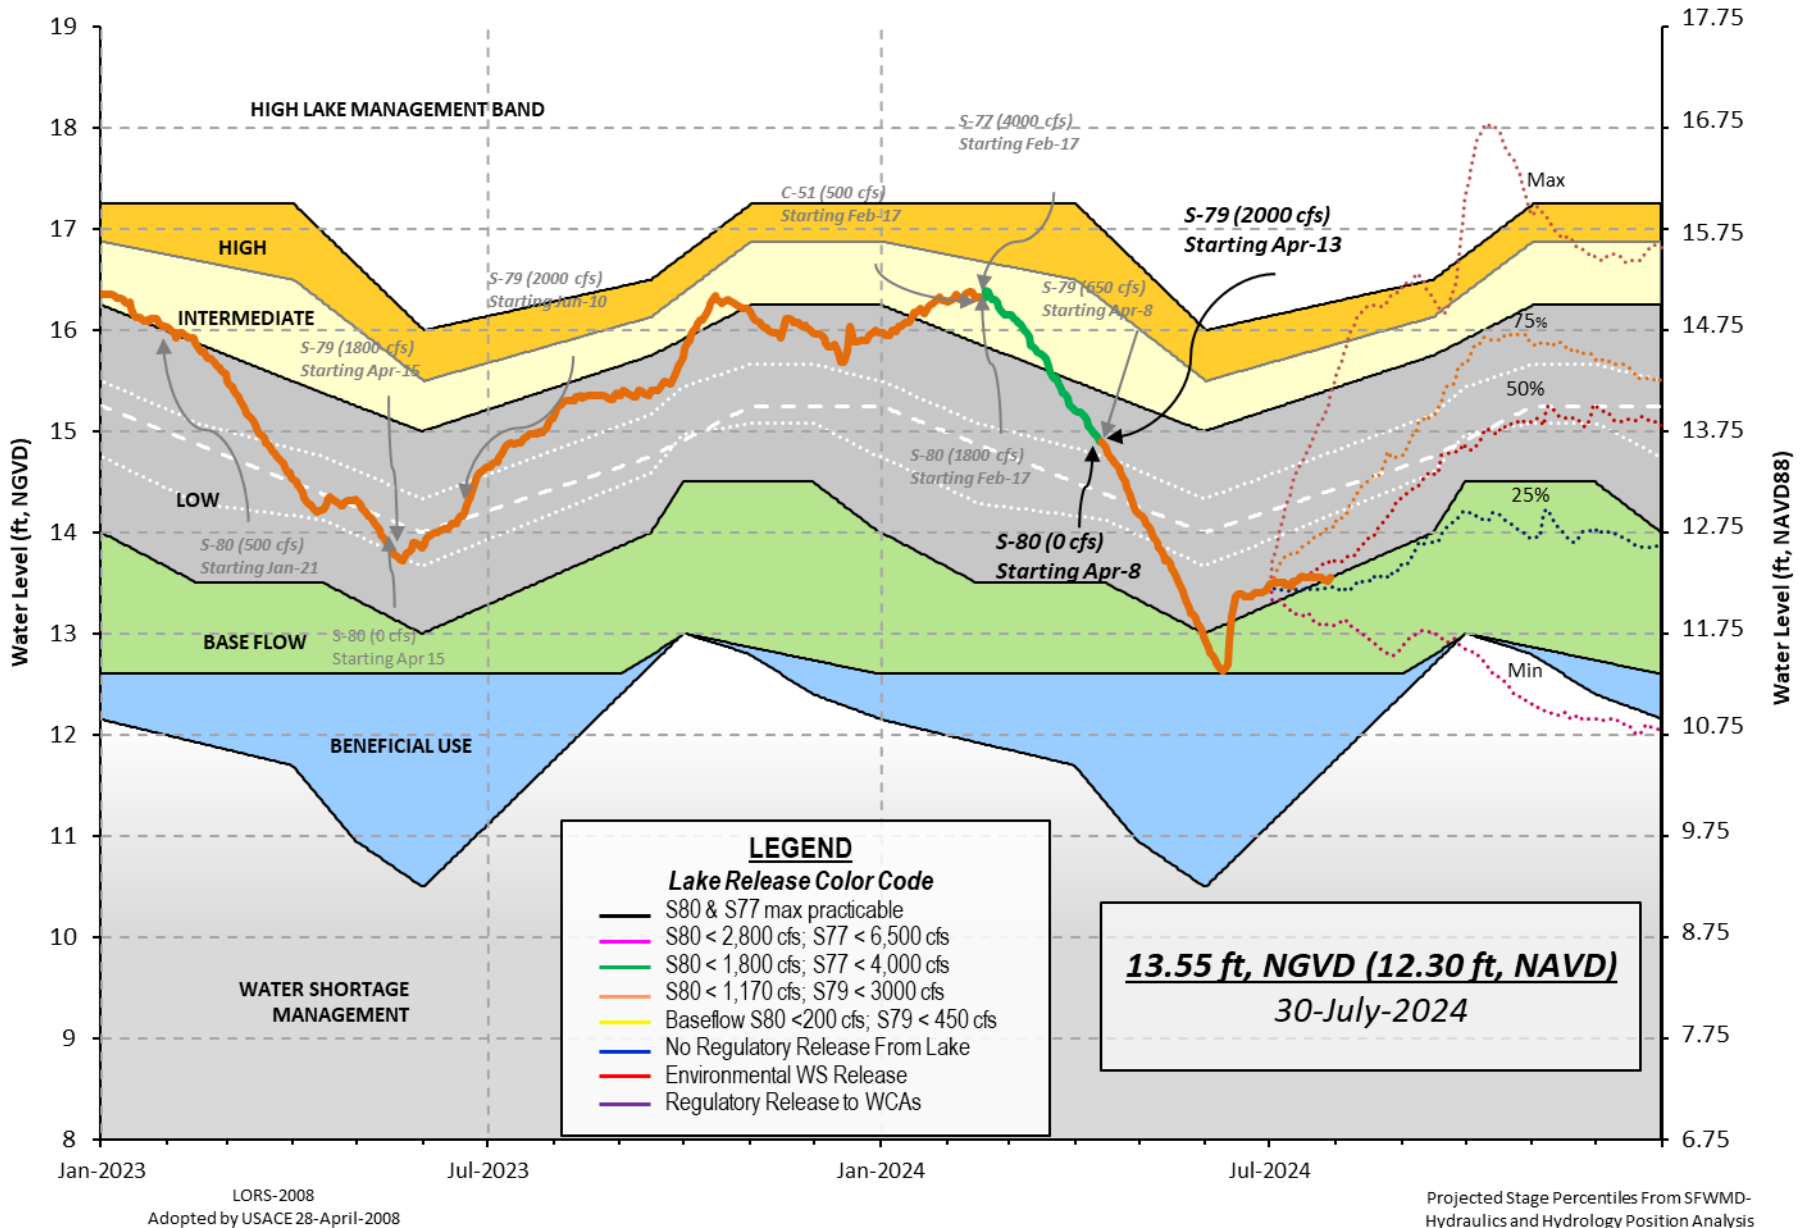

Stage is plotted in NGVD. Please use the left axis for water level history and projected stages. Lake Okeechobee stage NAVD88 offset of -1.25 is based on Final Regulation Schedule Conversion (5/19/2020).

U. S. Army Corps of Engineers, Jacksonville District  
 Lake Okeechobee and Vicinity Report  
 \*\* Preliminary Data - Subject to Revision \*\*

Data Ending 2400 hours 28 JUL 2024

---

Okeechobee Lake Regulation	Elevation (ft-NGVD)	Last Year (ft-NGVD)	2YRS Ago (ft-NGVD)
*Okeechobee Lake Elevation	13.52	15.03	13.02 (Official Elv)
Bottom of High Lake Mngmt=	16.27	Top of Water Short Mngmt=	11.68
Currently in Operational Management Band			

Simulated Average LORS2008 [1965-2000]	12.66
Difference from Average LORS2008	0.86

28JUL (1965-2007) Period of Record Average	13.73
Difference from POR Average	-0.21

Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations

++Navigation Depth (Based on 2007 Channel Condition Survey) Route 1  $\blacklozenge$  7.46'  
 ++Navigation Depth (Based on 2008 Channel Condition Survey) Route 2  $\blacklozenge$  5.66'  
 Bridge Clearance = 49.34'

---

4 Interior and 4 Edge Okeechobee Lake Average (Avg-Daily values):

L001	L005	L006	LZ40	S4	S352	S308	S133
13.51	13.58	13.51	13.46	13.52	13.68	13.44	13.44

\*Combination Okeechobee Avg-Daily Lake Average = 13.52  
 (\*See Note)

---

Okeechobee Inflows (cfs):

S65E	554	S65EX1	0	Fisheating Cr	207
S154	5	S191	0	S135 Pumps	0
S84	136	S133 Pumps	0	S2 Pumps	0
S84X	46	S127 Pumps	0	S3 Pumps	0
S71	0	S129 Pumps	0	S4 Pumps	0
S72	0	S131 Pumps	17	C5	0
Total Inflows:	965				

Okeechobee Outflows (cfs):

S135 Culverts	0	S354	0	S77	650
S127 Culverts	0	S351	0	S308	-1
S129 Culverts	0	S352	0		
S131 Culverts	0	L8 Canal Pt	82		
Total Outflows:	731				

\*\*\*\*S77 structure flow is being used to compute Total Outflow.  
 \*\*\*\*S308 structure flow is being used to compute Total Outflow.

Okeechobee Pan Evaporation (inches):

S77	0.11	S308	0.27
Average Pan Evap x 0.75 Pan Coefficient = 0.14" = 0.01'			

Lake Average Precipitation using NEXRAD: = -NR-" = -NR-'

Evaporation - Precipitation: = -NR-" = -NR-'  
 Evaporation - Precipitation using Lake Area of 730 square miles

is equal to -NR-  
 Lake Okeechobee (Change in Storage) Flow is -2118 cfs or -4200 AC-FT

	Headwater Elevation (ft-msl)	Tailwater Elevation (ft-msl)	Disch (cfs)	----- Gate Positions -----							
				#1 (ft)	#2 (ft)	#3 (ft)	#4 (ft)	#5 (ft)	#6 (ft)	#7 (ft)	#8 (ft)
(I) see note at bottom											
<b>North East Shore</b>											
S133 Pumps:	13.49	13.75	0	0	0	0	0	-NR-	(cfs)		
S193:											
S191:	18.74	13.69	0	0.0	0.0	0.0					
S135 Pumps:	13.34	13.43	0	0	0	0	0		(cfs)		
S135 Culverts:			0	0.0	0.0						
<b>North West Shore</b>											
S65E:	20.91	14.05	554	0.3	0.4	0.4	0.5	1.0	0.3		
S65EX1:	20.91	14.05	0								
S127 Pumps:	13.28	13.57	0	0	0	0	0	0	(cfs)		
S127 Culvert:			0	0.0							
S129 Pumps:	12.90	13.62	0	0	0	0			(cfs)		
S129 Culvert:			0	0.0							
S131 Pumps:	12.91	13.22	17	0	19				(cfs)		
S131 Culvert:			0								
<b>Fisheating Creek</b>											
nr Palmdale		31.76	207								
nr Lakeport											
S282	13.84	13.51		0.1	0.0	0.1					
<b>South Shore</b>											
S4 Pumps:	11.12	15.30	0	0	0	0			(cfs)		
S169:	13.61	5.85	0	0.0	0.0	0.0					
S310:			-NR-								
S3 Pumps:	10.29	13.51	0	0	0	0			(cfs)		
S354:	13.51	10.29	0	0.0	0.0						
S2 Pumps:	10.26	13.66	0	0	0	0	0		(cfs)		
S351:	13.66	10.26	0	0.0	0.0	0.0					
S352:	13.53	10.03	0	0.0	0.0						
S271:	14.05	14.01		9.5	9.7	-NR-	8.5				
L8 Canal PT		13.71	82								

S351 and S352 Temporary Pumps/S354 Spillway

S351:	10.26	13.66	0	-NR-	-NR-	-NR-	-NR-	-NR-	-NR-		
S352:	10.03	13.53	0	-NR-	-NR-	-NR-	-NR-				
S354:	10.29	13.51	0	-NR-	-NR-	-NR-	-NR-				

Caloosahatchee River (S77, S78, S79)

S47B:	12.35	12.16		0.0	0.0						
S47D:	12.26	11.54	0	0.0							
S77:											
Spillway and Sector Preferred Flow:	13.66	11.39	649	0.0	0.0	3.5	0.0				
Flow Due to Lockages+:			1								

S78:

Spillway and Sector Flow:  
 11.44 2.81 758 0.0 2.5 0.0 0.0  
 Flow Due to Lockages+: -NR-

S79:  
 Spillway and Sector Flow:  
 3.06 1.73 2544 0.0 0.0 2.0 3.0 2.5 2.0 0.0 0.0  
 Flow Due to Lockages+: 5  
 Percent of flow from S77 26%  
 Chloride (ppm) 0

St. Lucie Canal (S308, S80)

S308:  
 Spillway and Sector Preferred Flow:  
 13.58 14.16 0 0.0 0.0 0.0 0.0  
 Flow Due to Lockages+: -1

S153: 18.68 13.96 120 0.5 0.0

S80:  
 Spillway and Sector Flow:  
 14.17 0.34 0 0.0 0.0 0.0 0.0 0.0 0.0 0.0  
 Flow Due to Lockages+: 16  
 Percent of flow from S308 NA %

Steele Point Top Salinity (mg/ml) \*\*\*\*  
 Steele Point Bottom Salinity (mg/ml) \*\*\*\*

Speedy Point Top Salinity (mg/ml) \*\*\*\*  
 Speedy Point Bottom Salinity (mg/ml) \*\*\*\*

+ Flow Due to lockages is computed utilizing average daily headwater and tailwater along with total number of lockages for the day to calculate a volume which is then converted to an average discharge in cfs.

++ Preferred flow is determined from either the spillway discharge or the below flow meter daily

Daily Precipitation Totals	1-Day (inches)	3-Day (inches)	7-Day (inches)	----- Wind -----	
				Direction (Deg)	Speed (mph)
S133 Pump Station:	-NR-	0.00	0.00		
S193:	-NR-	0.00	0.00	-NR-	-NR-
Okeechobee Field Station:	-NR-	0.00	0.00		
S135 Pump Station:	-NR-	0.00	0.00		
S127 Pump Station:	-NR-	0.00	0.00		
S129 Pump Station:	-NR-	0.00	0.00		
S131 Pump Station:	-NR-	0.00	0.00		
S77:	16.86	17.31	17.86	171	-NR-
S78:	1.02	1.02	1.03	163	2
S79:	17.86	17.89	17.92	103	4
S4 Pump Station:	-NR-	0.00	0.00		
Clewiston Field Station:	-NR-	0.00	0.00		
S3 Pump Station:	-NR-	0.00	0.00		
S2 Pump Station:	-NR-	0.00	0.00		
S308:	0.00	0.00	0.00	4	2
S80:	17.58	17.58	17.73	-NR-	-NR-
Okeechobee Average (Sites S78, S79 and S80 not included)	8.43	1.33	1.37		
-----					
Oke Nexrad Basin Avg	-NR-	0.00	0.00		
-----					

Okeechobee Lake Elevations 28 JUL 2024 13.52 Difference from 28JUL24  
 28JUL24 -1 Day = 27 JUL 2024 13.53 0.01

28JUL24	-2 Days =	26 JUL 2024	13.53	0.01
28JUL24	-3 Days =	25 JUL 2024	13.55	0.03
28JUL24	-4 Days =	24 JUL 2024	13.56	0.04
28JUL24	-5 Days =	23 JUL 2024	13.55	0.03
28JUL24	-6 Days =	22 JUL 2024	13.55	0.03
28JUL24	-7 Days =	21 JUL 2024	13.56	0.04
28JUL24	-30 Days =	28 JUN 2024	13.42	-0.10
28JUL24	-1 Year =	28 JUL 2023	15.03	1.51
28JUL24	-2 Year =	28 JUL 2022	13.02	-0.50

Long Term Mean 30day Avearge ET for Lake Alfred (Inches) = -NR-

Lake Okeechobee Net Inflow (LONIN)

		Average Flow over the previous 14 days		Avg-Daily Flow
28JUL24	Today =	28 JUL 2024	530 MON	-1469
28JUL24	-1 Day =	27 JUL 2024	979 SUN	661
28JUL24	-2 Days =	26 JUL 2024	908 SAT	-3568
28JUL24	-3 Days =	25 JUL 2024	2518 FRI	-1338
28JUL24	-4 Days =	24 JUL 2024	2559 THU	2860
28JUL24	-5 Days =	23 JUL 2024	2104 WED	0
28JUL24	-6 Days =	22 JUL 2024	2394 TUE	-NR-
28JUL24	-7 Days =	21 JUL 2024	1757 MON	-NR-
28JUL24	-8 Days =	20 JUL 2024	1407 SUN	-NR-
28JUL24	-9 Days =	19 JUL 2024	1290 SAT	-NR-
28JUL24	-10 Days =	18 JUL 2024	1209 FRI	-NR-
28JUL24	-11 Days =	17 JUL 2024	1220 THU	-3175
28JUL24	-12 Days =	16 JUL 2024	1811 WED	5381
28JUL24	-13 Days =	15 JUL 2024	1453 TUE	5417

S65E

		Average Flow over previous 14 days		Avg-Daily Flow
28JUL24	Today=	28 JUL 2024	487 MON	614
28JUL24	-1 Day =	27 JUL 2024	479 SUN	435
28JUL24	-2 Days =	26 JUL 2024	481 SAT	518
28JUL24	-3 Days =	25 JUL 2024	486 FRI	511
28JUL24	-4 Days =	24 JUL 2024	485 THU	505
28JUL24	-5 Days =	23 JUL 2024	493 WED	514
28JUL24	-6 Days =	22 JUL 2024	508 TUE	523
28JUL24	-7 Days =	21 JUL 2024	505 MON	525
28JUL24	-8 Days =	20 JUL 2024	520 SUN	474
28JUL24	-9 Days =	19 JUL 2024	543 SAT	432
28JUL24	-10 Days =	18 JUL 2024	569 FRI	435
28JUL24	-11 Days =	17 JUL 2024	599 THU	457
28JUL24	-12 Days =	16 JUL 2024	616 WED	447
28JUL24	-13 Days =	15 JUL 2024	626 TUE	432

S65EX1

		Average Flow over previous 14 days		Avg-Daily Flow
28JUL24	Today=	28 JUL 2024	0 MON	0
28JUL24	-1 Day =	27 JUL 2024	0 SUN	0
28JUL24	-2 Days =	26 JUL 2024	0 SAT	0
28JUL24	-3 Days =	25 JUL 2024	0 FRI	0
28JUL24	-4 Days =	24 JUL 2024	0 THU	0
28JUL24	-5 Days =	23 JUL 2024	0 WED	0
28JUL24	-6 Days =	22 JUL 2024	0 TUE	0
28JUL24	-7 Days =	21 JUL 2024	0 MON	0
28JUL24	-8 Days =	20 JUL 2024	0 SUN	0
28JUL24	-9 Days =	19 JUL 2024	0 SAT	0
28JUL24	-10 Days =	18 JUL 2024	0 FRI	0
28JUL24	-11 Days =	17 JUL 2024	0 THU	0
28JUL24	-12 Days =	16 JUL 2024	0 WED	0
28JUL24	-13 Days =	15 JUL 2024	0 TUE	0

## Lake Okeechobee Outlets Last 14 Days

	S-77	Below S-77	S-78	S-79
	Discharge	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL-DAY)	(ALL DAY)	(ALL DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
28 JUL 2024	1297	-NR-	-NR-	5024
27 JUL 2024	1312	-NR-	1501	5390
26 JUL 2024	1324	-NR-	1494	4831
25 JUL 2024	1532	-NR-	1494	4999
24 JUL 2024	1501	-NR-	1422	5368
23 JUL 2024	4	-NR-	1426	5390
22 JUL 2024	221	-NR-	1483	4199
21 JUL 2024	666	-NR-	1497	4632
20 JUL 2024	663	-NR-	1509	4510
19 JUL 2024	662	-NR-	1487	5900
18 JUL 2024	1168	-NR-	1671	4090
17 JUL 2024	2097	-NR-	2070	4947
16 JUL 2024	2285	-NR-	2017	4841
15 JUL 2024	2266	-NR-	2687	5502

	S-310	S-351	S-352	S-354	L8 Canal Pt
	Discharge	Discharge	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)	(ALL DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)	(AC-FT)
28 JUL 2024	-NR-	0	0	0	163
27 JUL 2024	-NR-	0	0	0	163
26 JUL 2024	-NR-	0	0	0	163
25 JUL 2024	-NR-	0	0	0	162
24 JUL 2024	-NR-	0	0	0	162
23 JUL 2024	-NR-	0	0	0	162
22 JUL 2024	-NR-	0	0	0	163
21 JUL 2024	-NR-	0	0	0	161
20 JUL 2024	-NR-	0	0	0	162
19 JUL 2024	-NR-	0	0	0	162
18 JUL 2024	-NR-	0	0	0	162
17 JUL 2024	-NR-	0	0	0	162
16 JUL 2024	-NR-	0	0	0	163
15 JUL 2024	-NR-	0	0	0	162

	S-308	Below S-308	S-80
	Discharge	Discharge	Discharge
	(ALL DAY)	(ALL-DAY)	(ALL-DAY)
DATE	(AC-FT)	(AC-FT)	(AC-FT)
28 JUL 2024	-3	-NR-	31
27 JUL 2024	-2	-NR-	46
26 JUL 2024	-1	-NR-	19
25 JUL 2024	-2	-NR-	27
24 JUL 2024	-3	-NR-	27
23 JUL 2024	-2	-NR-	19
22 JUL 2024	-NR-	-NR-	23
21 JUL 2024	-NR-	-NR-	28
20 JUL 2024	-NR-	-NR-	-NR-
19 JUL 2024	-NR-	-NR-	-NR-
18 JUL 2024	-NR-	-NR-	16
17 JUL 2024	-2	-NR-	-NR-
16 JUL 2024	-3	-NR-	-NR-
15 JUL 2024	-3	-NR-	28

\*\*\* NOTE: Discharge (ALL DAY) is computed using Spillway, Sector Gate and Lockages Discharges from 0015 hrs to 2400 hrs.

(I) - Flows preceded by "I" signify an instantaneous flow computed from the single value reported for the day


- 
- \* On 11 May 1999, Lake Okeechobee Elevation was switched from Instantaneous 2400 value to an average-daily lake average.
  - On 14 Mar 2001, due to the isolation of various gages within the standard 10 stations, the average of the interior 4 station gages was used as the Lake Okeechobee Elevation.
  - On 05 November 2010, Lake Okeechobee Elevation was switched to a 9 gage mix of interior and edge gages to obtain a more reliable representation of the lake level.
  - On 09 May 2011, Lake Okeechobee Elevation was switched to a 8 gage mix of interior and edge gages to obtain a more reliable representation of the lake level due to isolation of S135 from low lake levels.
  - Today Lake Okeechobee elevation is determined from the 4 Int & 4 Edge stations
- ++ For more information see the Jacksonville District Navigation website at <http://www.saj.usace.army.mil/>
- \$ For information regarding Lake Okeechobee Service Area water restrictions please refer to [www.sfwmd.gov](http://www.sfwmd.gov)

---

Report Generated 29JUL2024 @ 23:38 \*\* Preliminary Data - Subject to Revision \*\*

# Lake Okeechobee

29JUL24 13:00:18

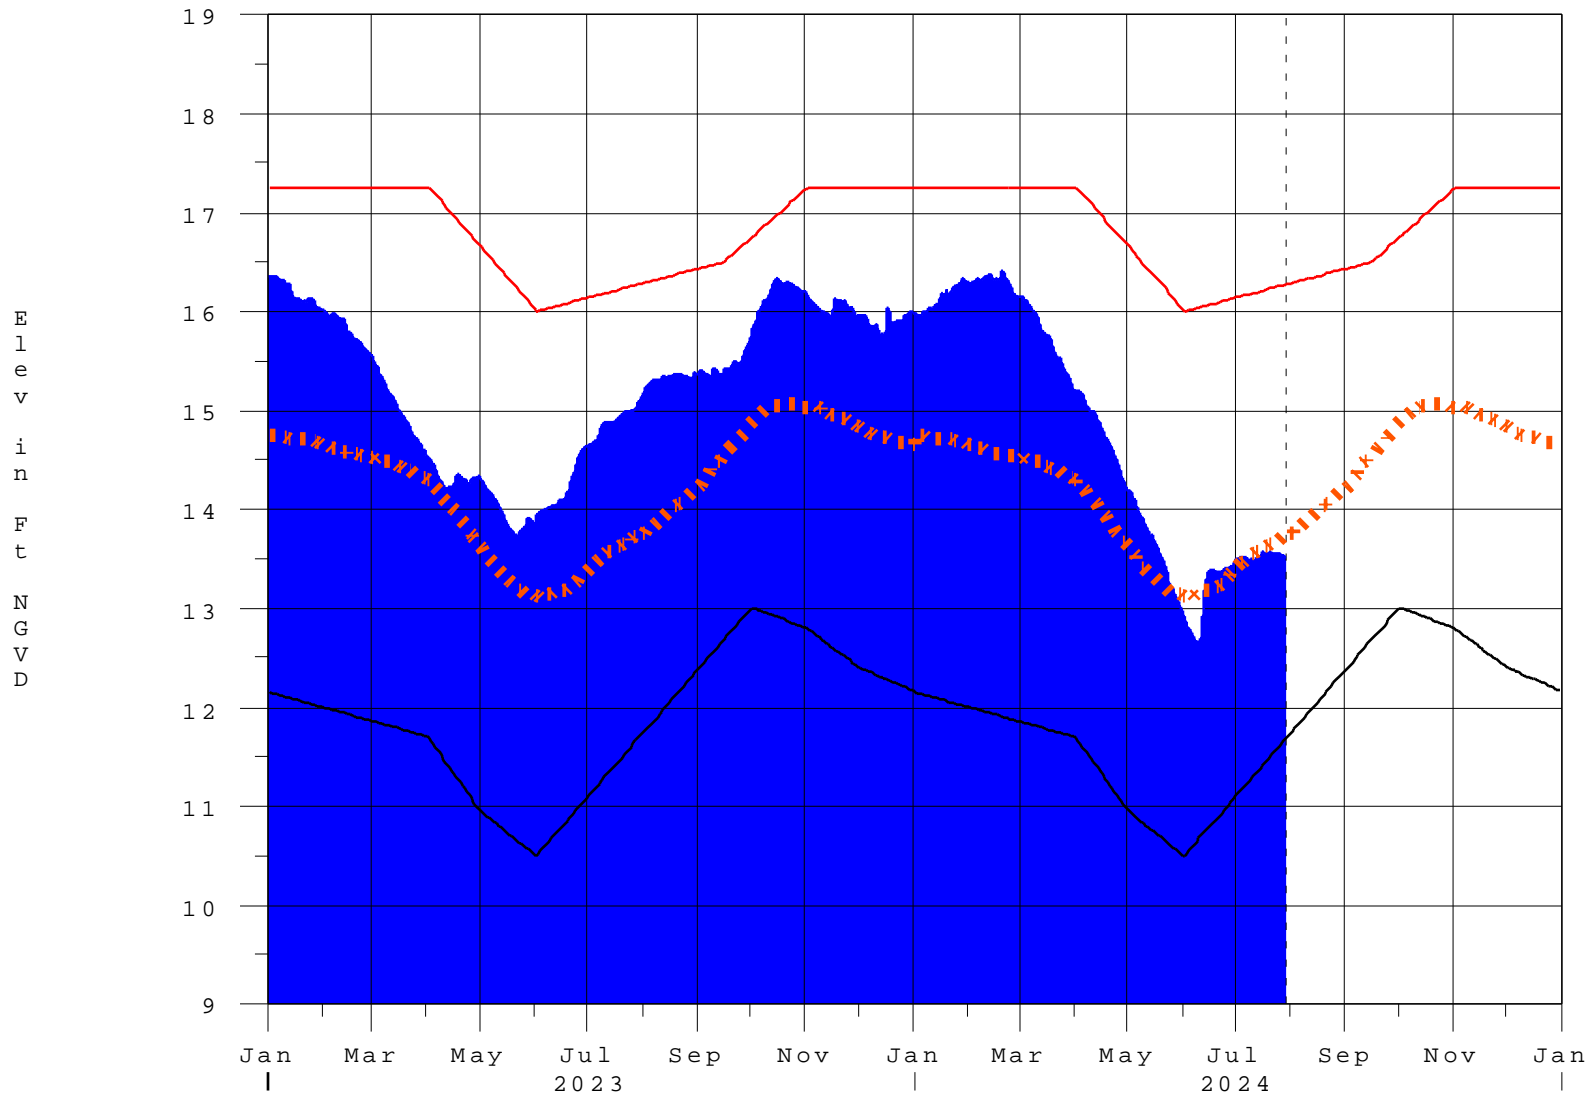

- High Lake Management
- Okeechobee Avg Elev
- Average Elev [1965-2007]
- Water Shortage Management



# Classification Tables

---

Supplemental Tables used in conjunction with the LORS2008 Release

Guidance Flow Charts

- [Class Limits for Tributary Hydrologic Conditions](#)

Table K-2 in the Lake Okeechobee Water Control Plan

- [6-15 Day Precipitation Outlook Categories](#)

Table ?? in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Seasonal Outlook](#)

Table K-3 in the Lake Okeechobee Water Control Plan

- [Classification of Lake Okeechobee Net Inflow for Multi-Seasonal Outlook](#)

Table K-4 in the Lake Okeechobee Water Control Plan

---

[Back to Lake Okeechobee Operations Main Page](#)

[Back to U.S. Army Corps of Engineers Lake Okeechobee Operations Homepage](#)

Tributary Hydrologic Classification*	Palmer Index Class Limits	2-wk Mean L.O. Net Inflow Class Limits
Very Wet	3.0 or greater	Greater $\geq$ 6000 cfs
Wet	1.5 to 2.99	2500 - 5999 cfs
Near Normal	-1.49 to 1.49	500 - 2499 cfs
Dry	-2.99 to -1.5	-5000 – 500 cfs
Very Dry	-3.0 or less	Less than -5000 cfs

\* use the wettest of the two indicators

**Classification of Lake Okeechobee Net Inflow Seasonal Outlook\***

<b>Lake Net Inflow Prediction</b> <b>[million acre-feet]</b>	<b>Equivalent Depth**</b> <b>[feet]</b>	<b>Lake Okeechobee</b> <b>Net Inflow</b> <b>Seasonal Outlook</b>
> 0.93	> 2.0	Very Wet
0.71 to 0.93	1.51 to 2.0	Wet
0.35 to 0.70	0.75 to 1.5	Normal
< 0.35	< 0.75	Dry

**\*\*Volume-depth conversion based on average lake surface area of 467,000 acres**

## Classification of Lake Okeechobee Net Inflow Multi-Seasonal Outlook\*

<b>Lake Net Inflow Prediction</b> <b>[million acre-feet]</b>	<b>Equivalent Depth**</b> <b>[feet]</b>	<b>Lake Okeechobee Net Inflow Multi-Seasonal Outlook</b>
> 2.0	> 4.3	Very Wet
1.18 to 2.0	2.51 to 4.3	Wet
0.5 to 1.17	1.1 to 2.5	Normal
< 0.5	< 1.1	Dry

**\*\*Volume-depth conversion based on average lake surface area of 467,000 acres**

**6-15 Day Precipitation Outlook Categories\***

<b>6-15 Day Precipitation Outlook Categories</b>	<b>WSE Decision Tree Categories</b>
Above Normal	Wet to Very Wet
Normal	Normal
Below Normal	Dry

\* Corresponds to Table 7-6 in the Lake Okeechobee Water Control Plan

Under Construction